

Article

Not peer-reviewed version

A Simple Procedure to Obtain the Grounding Resistance Measure of Very Large and Urban Electrodes by a Modified Fall-of-Potential Method

[Jorge Moreno](#) , Pascual Simon , [Eduardo Faleiro](#) * , Daniel Garcia , [Gregorio Denche](#) , [Gabriel Asensio](#)

Posted Date: 19 August 2024

doi: 10.20944/preprints202408.1368.v1

Keywords: very large and urban grids; modified Fall-of-Potential method; corrected unitary grounding resistance; grounding electrode status



Preprints.org is a free multidiscipline platform providing preprint service that is dedicated to making early versions of research outputs permanently available and citable. Preprints posted at Preprints.org appear in Web of Science, Crossref, Google Scholar, Scilit, Europe PMC.

Copyright: This is an open access article distributed under the Creative Commons Attribution License which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

Article

A Simple Procedure to Obtain the Grounding Resistance Measure of Very Large and Urban Electrodes by a Modified Fall-of-Potential Method

Jorge Moreno ¹, Pascual Simón ², Eduardo Faleiro ^{1,*}, Daniel García ¹, Gregorio Denche ¹ and Gabriel Asensio ¹

¹ Escuela Técnica Superior de Ingeniería y Diseño Industrial, Universidad Politécnica de Madrid, 28012 Madrid, Spain

² LCOE Laboratory, Calle Diesel 13. P.I. El Lomo, 28906 Madrid, Spain

* Correspondence: eduardo.faleiro@upm.es

Featured Application: This paper presents a simple method for correcting field measurements of grounding resistance, allowing for a highly accurate value of this parameter to be obtained.

Abstract: The measurement of the grounding resistance of protection grids in large installations as well as grounding electrodes in urban areas is addressed in this article. The resistance value is obtained using a three-pin array by measuring the fall-of-potential on the ground surface. The resistance measured by this method is corrected using the so-called correction factor that adjusts the measured resistance value to its real value. The proposed measurement method obtains correct values of the grounding resistance even when the auxiliary and potential electrodes of the tree-pin array are close to the electrode to be measured. Thus, it can be applied to large electrodes as well as electrodes in urban areas. Several simulated examples are used to illustrate the method, and some real cases with field measurements are presented for a final validation of the method.

Keywords: very large and urban grids; modified Fall-of-Potential method; corrected unitary grounding resistance; grounding electrode status

1. Introduction

Grounding resistance is one of the most important parameters determining the suitability of a protection installation. Its determination is an important issue and many studies have focused on it. Although it is possible to theoretically calculate its value provided the physical configuration and burial parameters are known [1–4], field measurement is a mandatory task. Among the various methods of measuring the earthing resistance of an operating electrode [5], the well-known fall-of-potential method (FOPM) is one of the simplest and most effective. This method involves externally connecting the electrode to be measured to a current source and another auxiliary electrode located far away at a distance D , forming a circuit that closes as current passes through the ground from the electrode being measured to the distant auxiliary electrode, that is, a three-pin arrangement. The procedure is completed by measuring the potential difference between the electrode and an auxiliary probe driven into the ground at an appropriate distance x from it. For a very specific value of this distance, around $0.618D$, the ratio between the measured potential difference and the injected current provides the value of the grounding resistance of the electrode. This is known as the 62% rule [6]. This is always satisfied provided that the electrode to be measured is small, D is very large, and x is large enough so that from distance x the electrode behaves like a point source of current at ground level [7].

To measure extensive electrodes associated with large installations, the size of the electrodes presents a problem since it would be necessary to place the auxiliary potential probe at a considerable distance to meet the requirements of the 62% rule. Not to mention the auxiliary current electrode,

which must be placed even farther away from the electrode, severely compromising the proper functioning of the circuit that closes through the ground loop. This would require a more intense current injection for the measurement method to work properly. Several attempts have been made to avoid the limitations of FOPM when it is not possible to move the auxiliary current electrode far enough away [8–11]. Some modifications of the FOPM have been proposed [12,13] and the effect of surrounding electrodes and other conductors on FOPM measurements have been studied [14].

Currently, in the European context, the measurement of grounding resistance for large electrodes in electrical installations with alternating current voltages above 1 kV connected to transmission lines is carried out in accordance with the EN 50522 standard [15]. According to this standard, it is necessary to inject current through the grounding system of a transmission line tower at the substation. The tower must be sufficiently distant so that both electrodes can be considered isolated. This will create a measurable potential rise in the ground at the electrode being tested, which can be used to evaluate the grounding resistance. Despite the apparent simplicity described, the procedure is complex and costly to execute, as it requires handling the transmission line used.

In this paper, a new modification of the classic FOPM is proposed, which is applicable to situations like those described above without requiring the potential probe to be placed far from the edge of an extensive grounding mesh. The only requirement to maintain is that the auxiliary current electrode remains as far away from the mesh as possible. Moreover, the farther this electrode is from the mesh, the better the measurements obtained. This is achieved by defining a correction factor that must be multiplied by the field measurement result of the resistance to obtain the correct grounding resistance value of the mesh. The correction factor depends on the nature of the grounding electrode and the theoretical potentials it generates around it through current injection. It can be considered a factory parameter of the electrode and can therefore be calculated theoretically. In the following sections, the correction factor will be defined and calculated through some simulated examples and applied to the determination of the grounding resistance of extensive electrodes. Some real cases will be presented and analyzed. Finally, the conclusions and recommendations will be detailed in the final section of this paper.

2. Theoretical Background

The three-pin method is represented in Figure 1. The electrode to be measured is connected to a distant auxiliary electrode through a current source with intensity I .

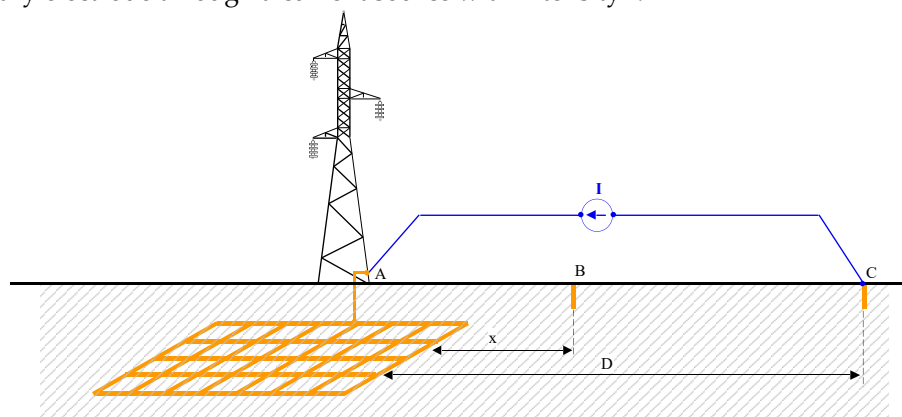


Figure 1. Practical illustration of the Three-Pin method for measuring the grounding resistance R_G .

The circuit is completed through the ground. The potential difference between points A and B is

$$\begin{aligned}
V_A &= V_e - \frac{\rho I}{2\pi D} \\
V_B(x) &= \frac{\rho I}{2\pi x} - \frac{\rho I}{2\pi(D-x)} \\
V_A - V_B(x) &= V_e - \frac{\rho I}{2\pi} \left(\frac{1}{D} + \frac{1}{x} - \frac{1}{D-x} \right)
\end{aligned} \tag{1}$$

In expression (1), V_e is the potential of the electrode when it is isolated, i.e., the grounding potential. Additionally, it is implicitly assumed that at point x , both the grounding electrode and the auxiliary current electrode behave as point sources of current at ground level. The same applies to the auxiliary electrode with respect to point A. This question should be discussed in the case of long electrodes or not very large distances D .

Based on expression (1), the measured grounding resistance R_G^{meas} is defined as

$$R_G^{meas}(x) = \frac{V_A - V_B(x)}{I} = R_G - \frac{\rho}{2\pi} \left(\frac{1}{D} + \frac{1}{x} - \frac{1}{D-x} \right) \tag{2}$$

where R_G is the true grounding resistance. It is clear that $R_G^{meas} = R_G$ for any given value of x , provided that the quantity in brackets in (2) $\left(\frac{1}{D} + \frac{1}{x} - \frac{1}{D-x} \right) = 0$ is zero. Thus, solving for the value of x , it gives $x = 0.618 \cdot D$, known as the 62% rule, provided that the assumptions mentioned above are satisfied. In summary, by placing the auxiliary electrode at a sufficiently distant location D from the grounding point, this rule can be applied to obtain values that are very close to the true grounding resistance.

It is evident that the analysis presented here cannot be applied when measuring an extensive electrode or also when the distance D is not large enough to ensure that the potential generated by the auxiliary current electrode on the electrode to be measured is $\frac{\rho I}{2\pi D}$ as the implicit assumptions described above are no longer valid. An extensive mesh cannot behave like a point source of current unless viewed from an immensely large distance. It also cannot be applied if there is not enough space to place the auxiliary electrode sufficiently far away, even if the grounding system is not very extensive. Since the electrode can no longer be assimilated to a current point,

$$\begin{aligned}
V_A &= V_e - \frac{\rho I}{2\pi D} \\
V_B(x) &= V_e(x) - \frac{\rho I}{2\pi(D-x)} \\
V_A - V_B(x) &= V_e - V_e(x) - \frac{\rho I}{2\pi D} + \frac{\rho I}{2\pi(D-x)}
\end{aligned} \tag{3}$$

where $V_e(x)$ is the potential created by the electrode at point x , considered as isolated and the distance D is not well defined since it must correspond to the distance at which V_A coincides with the true potential of the electrode. Dividing by the injected current I ,

$$R_G^{meas}(x) = \frac{V_A - V_B(x)}{I} = R_G - \frac{V_e(x)}{I} + \frac{\rho}{2\pi} \left(\frac{1}{D-x} - \frac{1}{D} \right) \tag{4}$$

Note that from expression (4), $R_G^{meas} = R_G$, if and only if $V_e(x) = \frac{\rho I}{2\pi} \left(\frac{1}{D-x} - \frac{1}{D} \right)$ for some value of x , otherwise will be above or below R_G depending on the value of x . This condition is equivalent to the 62% rule when it is not possible to assume that the electrode to be measured behaves as a current point. Next, the so-called correction factor $k_m(x)$ will be introduced. It is defined as the ratio between the true grounding resistance and the resistance measured in the field $k_m(x) = \frac{R_G}{R_G^{meas}(x)}$.

According to (4), it can be written as

$$k_m(x) = \frac{R_G}{R_G - \frac{V_e(x)}{I} + \frac{\rho}{2\pi} \left(\frac{1}{D-x} - \frac{1}{D} \right)} = \frac{k_\rho}{k_\rho - k_p(x) + \frac{1}{2\pi} \left(\frac{1}{D-x} - \frac{1}{D} \right)} \quad (5)$$

where the coefficients $k_\rho = \frac{R_G}{\rho}$ and $k_p(x) = \frac{V_e(x)}{\rho I}$ have been introduced. These coefficients k_ρ , $k_p(x)$ turn out to be parameters of the electrodes and can be calculated for single-layered soils of resistivity ρ .

Therefore, the proposed method requires precise knowledge of the nature, geometry, and placement of the electrode, information that is presumably available, with which to evaluate k_ρ and $k_p(x)$. Once $k_m(x)$ is obtained for a specific position of the potential probe, the electrode resistance $R_G^{meas}(x)$ is measured, and the grounding resistance is found using $R_G = k_m(x) \cdot R_G^{meas}(x)$. Since these expressions have been derived from a drastic simplification, such as considering an extensive electrode as a point source at short distances, it is expected that R_G will depend on x and actually represent an upper bound to the true grounding resistance value. It should be noted that in the three-pin method, the measured resistance $R_G^{meas}(x)$ is always lower than the real value.

As a comment, the denominator of (5) contains actually the touch potential of the electrode at distance x per unit of current and soil resistivity, known as $k_c(x)$ and defined by $k_c(x) = \frac{V_e - V_e(x)}{\rho I}$, so (5) can also be expressed as

$$k_m(x) = \frac{k_\rho}{k_c(x) + \frac{1}{2\pi} \left(\frac{1}{D-x} - \frac{1}{D} \right)} \quad (6)$$

The magnitude $k_c(x)$ can be evaluated theoretically, just like $k_p(x)$, given the nature, geometry, and positioning of the electrode in the soil. When dealing with extensive electrodes or with auxiliary current electrodes close to the electrode being measured, it becomes necessary to determine the appropriate value of D to use. It might be useful to rewrite (6) by introducing two distances,

$$k_m(x) = \frac{k_\rho}{k_c(x) + \frac{1}{2\pi} \left(\frac{1}{D_1-x} - \frac{1}{D_2} \right)} \quad (7)$$

where D_1 represents the distance between the auxiliary current electrode and the coordinate origin used to define the electrode being measured and D_2 is the optimal distance from the auxiliary electrode to the electrode being measured to obtain the potential V_A according to the first equation in (3). In critical situations, that is, when D_1 is not very large, we propose averaging R_G evaluated with two different values of D_2 , corresponding to the nearest and farthest distances from the auxiliary electrode to the extensive electrode being measured. It is easy to see that $D_1 \approx D_2$ if both are large compared to the size of the electrode being measured so the point current approximation for the grounding electrode becomes quite accurate.

In the proposed method, we start with a known "theoretical" electrode for which it is possible to calculate $k_c(x)$, k_ρ and therefore $k_m(x)$ according to (6). However, the electrode to be measured may not exactly correspond to the "theoretical" electrode. It may be altered for various reasons, so its resistance will not match the theoretical resistance. If we measure $R_G^{meas}(x)$, then applying the correction factor $k_m(x)$ will not result in R_G . The main causes include oxidation or deterioration of the conductors that make up the electrode. Besides, the measurement can also be altered because the electrode is interconnected with other external grounds. This is a common practice that significantly reduces the resistance of the joint ground. With electrode deterioration the measure

typically leads to grounding resistances $R_G^{meas}(x)$ somewhat higher than those of the unaltered electrode, which, when multiplied by the correction factor, results in an overestimation of R_G . Thus, generally the result will be $R_G \leq k_m(x) \cdot R_G^{meas}(x)$. However, for interconnected electrodes, the measurement will give an underestimation of R_G . In either case, the proposed method will give the correct reading that corresponds to the case, and it is the task of the technical staff to determine the usefulness of the measurements. This hypothesis will be verified with the help of a numerical example in which a flat square electrode with a side length of 4 meters, made of conductive rods with a radius of 9mm, is buried at a depth of 0.5 meters. The soil is considered homogeneous with unitary resistivity. We are going to simulate the measurement of the grounding resistance by placing an auxiliary current rod 200 meters away from the electrode using the fall-of-potential method. For the same type of electrode, two situations will be addressed. In one case, the electrode has no issues, while in the other, it is assumed that part of the electrode is damaged and inactive in releasing current to the ground. Figure 2 shows the profiles of the electrode, and the dotted line represents the path traced to evaluate the potentials on the ground.

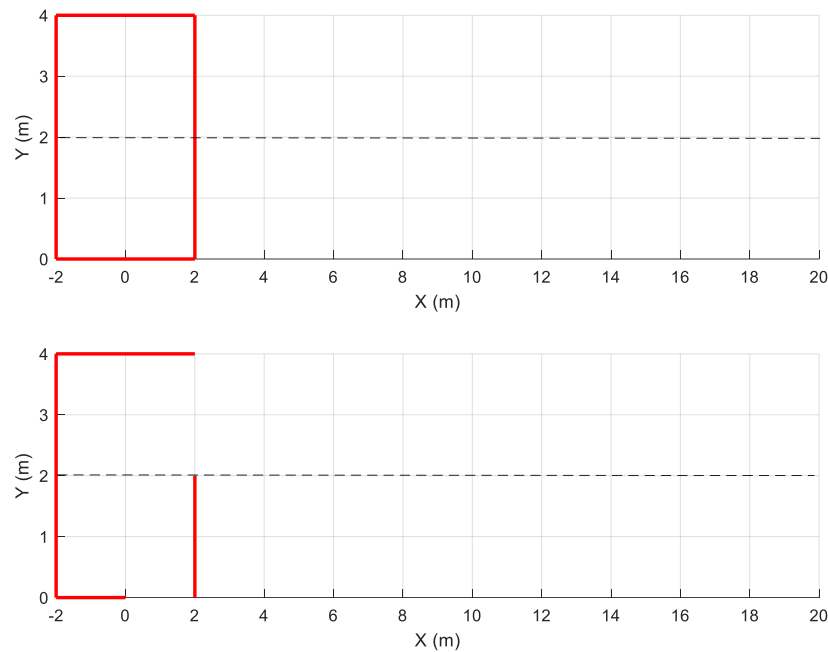


Figure 2. The upper panel shows the electrode being studied, while the lower panel represents the same electrode partially damaged.

The difference of potential profile $V_A - V_B(x)$ at points on the ground ($z=0$) along a straight line from the left side of the electrode at $x=-2m$ to $x=180m$ when the y -coordinate is fixed at $y=2m$, will be measured for both electrodes. Since the soil has a unit resistivity and the injected current is 1A, this potential difference represents the unit grounding resistance as a function of the distance x at which the potential probe is located, measured by the three-pin method, when the auxiliary electrode is, as previously mentioned, 200 meters from the electrode being measured.

Figure 3 shows the grounding resistance measured using the three-pin method, placing the potential electrode at distance x . The figure shows this measured resistance for both the original (red line) and the damaged electrode (beige line). The figure also shows the resistance corrected by the correction factor k_m , which is shown in the subfigure. The blue line is the result of this correction for the original electrode. As seen, the value $R_G = 0.1114 \Omega$ corresponding to the true resistance of the original electrode is obtained. In contrast, for the damaged electrode, applying the correction factor results in an R_G value above the true resistance value, which is 0.1266Ω . Note that the correction

factor is derived from the original electrode parameters and is applied to all situations, whether the electrode is damaged or not.

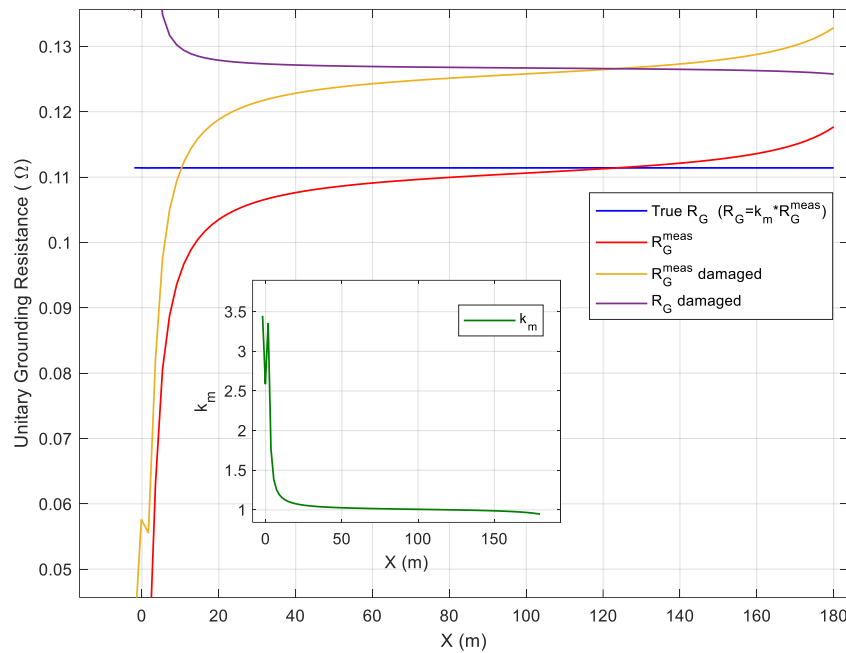


Figure 3. The measured grounding resistance profile for the original electrode (red line) and for the damaged electrode (beige line).

3. Application to Real Cases for Validation of the Method

The method described in the previous section will be applied to two real large electrodes. In the first case, the field measurement of the grounding resistance using the three-pin method will be simulated. In the second case, the resistance of the electrode is obtained from real field data.

3.1. Grounding Grid of the Balaidos Substation

The method described in the previous section will be applied to determine the grounding resistance of an extensive electrode, such as the grounding grid of the Balaidos substation in Vigo, Galicia, Spain. The technical characteristics of the mesh are cited below. Specifically, the resistance of the grounding electrode of the Balaidos electrical substation belonging to the Electric Company Unión Fenosa, located in Vigo, Galician Community (Spain), will be estimated. Figure 4 shows the geometric structure of the electrode, which is a non-regular grid formed by rods of variable length.

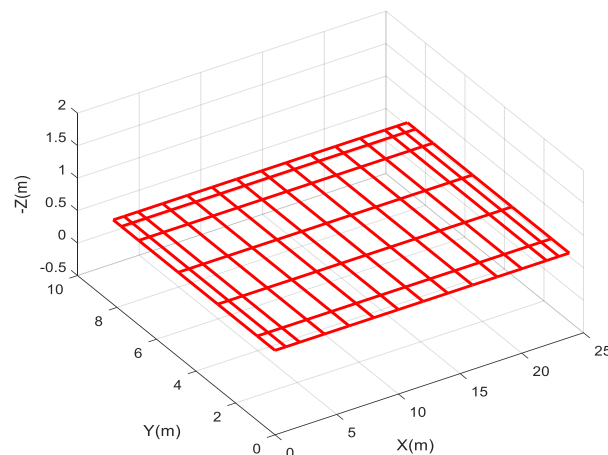


Figure 4. The Balaidos substation grounding grid.

The electrode of 4 mm radius is buried at a depth of 0.8 m and the parameter $k_R = \frac{R_G}{\rho}$ is previously known. The value is $k_0 = 0.02766 \Omega/\Omega\text{m}$, which represents the unitary grounding resistance provided that $\rho = 1 \Omega\text{m}$. The measurement using the three-pin method is simulated with the help of an auxiliary current electrode at a distance of 300 meters from the long edge of the mesh. Given the large distance between the auxiliary electrode and the grounding grid, we will assume $D_1 \approx D_2 = 300 \text{ m}$ in (7). The soil is considered to be a single layer with unit resistivity, and the current injected into the mesh-auxiliary electrode circuit is 1 ampere. The absolute potential generated by the isolated mesh in the surrounding area can be simulated. Specifically, considering the dashed path drawn in the subfigure of Figure 5, the absolute potential at points along this path is shown.

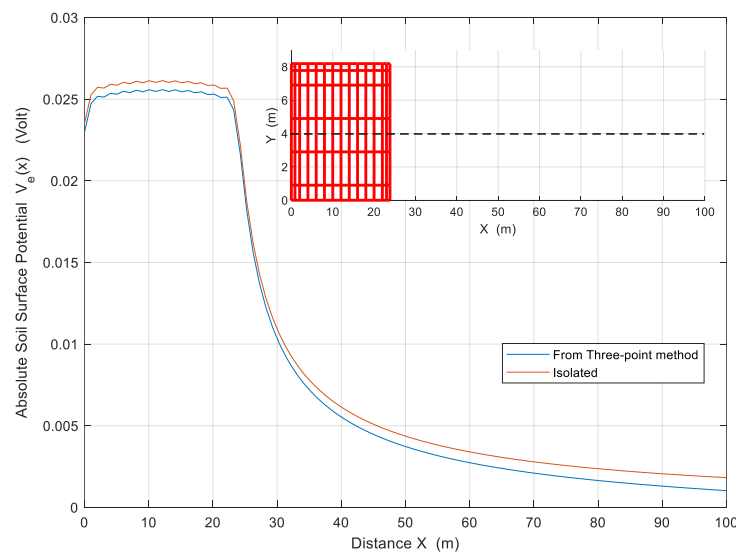


Figure 5. Balaidos grid with the indicative line on the ground where the absolute potential is measured by the three-pin method (blue line) when auxiliary rod is 300 m far away. The absolute potential created by the isolated grid is also shown (red line).

Figure 6 shows the variation of the measured resistance $R_G^{meas}(x)$ (blue line) with the coordinate x from the edge of the mesh, as well as the correction factor $k_m(x)$ corresponding to the single grid and theoretically calculated (subfigure blue line). The product $R_G = k_m(x) \cdot R_G^{meas}(x)$ is shown (red line), which ideally represents the true grounding resistance of the electrode obtained from the measurement at distance x . It can be observed that R_G is almost everywhere constant and equals the true grounding resistance value $R_G = 0.02766 \Omega$.

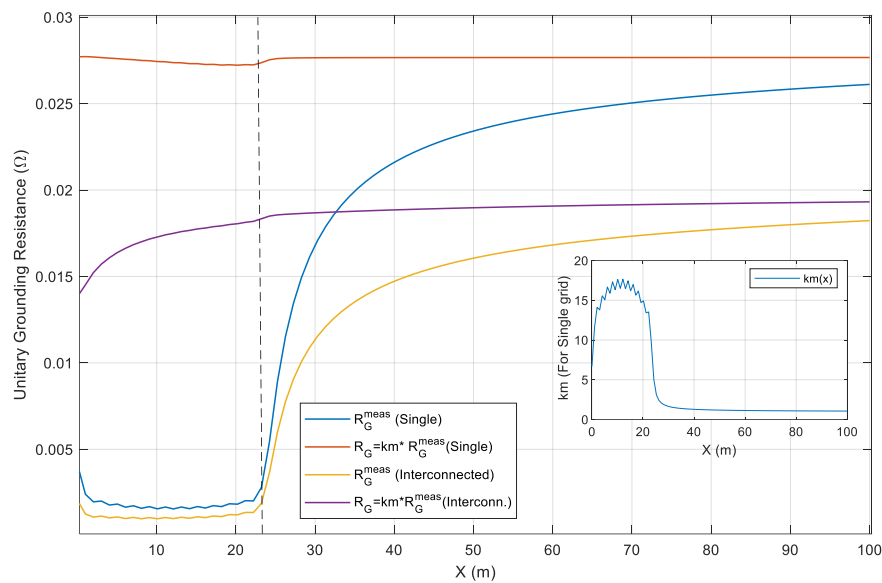


Figure 6. Representation of the different measurement procedure parameters as a function of the distance from the edge of the Balaidos grid. An interconnected case with other grounding system is also considered.

Figure 6 also illustrates the situation where the Balaidos grid is interconnected with another distant grid that is part of an external grounding system. In this case, a fault either in Balaidos or in the distant installation causes both grounding systems to act as one. The figure shows the field measurement of the combined grounding (beige line), while the magenta line represents the product of this measured resistance by the correction factor k_m from Balaidos grid as isolated. The result is an almost constant graph, which is also equal to the grounding resistance of the interconnection. In this case, $R_G = 0.01912 \Omega$, which is 3% lower than the theoretical value of the combined grounding system $R_G = 0.01963 \Omega$.

3.2. Grounding Grid of the Loeches Substation

Loeches is a large substation located in Loeches (Madrid), with approximate dimensions of 350 meters in length by 250 meters in width. The substation, owned by Union Fenosa Distribucion (UDF), has voltage levels of 132 kV, 45 kV, and 15 kV, and is located next to another large substation owned by Red Eléctrica de España, with a voltage level of 220 kV. In Figure 7, the 45 kV/15kV section of the UFD substation is outlined in red.

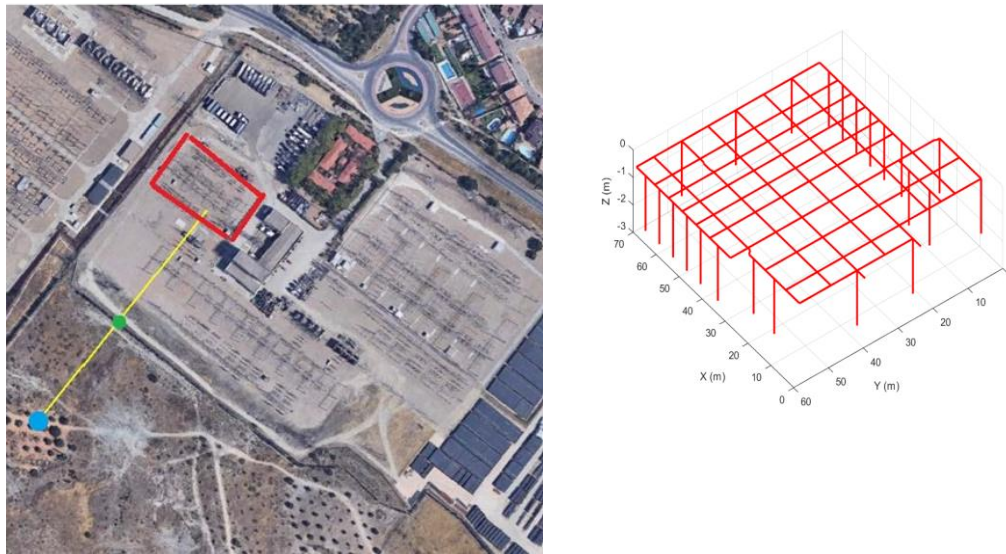


Figure 7. In the left panel, the Loeches substation, marked in red. The blue dot is the auxiliary current electrode 211 meters away from the grid edge. (Courtesy of Union Fenosa Distribucion, UFD). The grounding grid is shown on the right panel.

The auxiliary current electrode used, consisting of 4 copper rods connected in parallel and spaced approximately 2 meters apart, was installed at a distance of about 100 meters from the substation perimeter fence (green dot). In Figure 7, the position of the auxiliary current electrode is shown as a blue dot. To measure the substation grounding resistance, an auxiliary voltage electrode was used, consisting of a rod driven into the ground at an approximate distance of 40 meters from the substation perimeter fence, in the direction of the current electrode.

Based on the technical data of the grounding electrode shown in the right panel of Figure 7, it is easy to calculate $k_p = 0.00787 \Omega/\Omega\text{m}$ and $k_c(x)$, along the yellow line shown in Figure 7, to finally evaluate $k_m(x)$ according to (7). For this final step, $D_1=271$ m, and D_2 will take two values, 271 meters and 211 meters from the auxiliary electrode, since the coordinate origin on the ground is the point ($X_0 = 35$ m, $Y_0 = 0$). With respect to this coordinate origin, the potential probe is located at the point with coordinates ($X_p = 35$ m, $Y_p = 211$ m, $Z_p = 0$).

Figure 8 shows the results of the analysis. The solid blue line represents, as in previous examples, the field measurement values of the electrode resistance using the FOPM $R_G^{meas}(x)$. These values are expressed as unit resistance, knowing that the estimated soil resistivity is $\rho = 59.5 \Omega\text{m}$. The solid red and beige lines represent the corrected values of $R_G^{meas}(x)$ using the correction coefficient k_m evaluated with $D_2 = 211$ m and $D_2 = 271$ m, respectively and $D_1=271$ m, according to (7). Finally, the magenta dashed line shows the average of both corrections, corresponding to the estimated resistance of the electrode. The figure also shows the value measured by the potential probe 40 meters from the perimeter fence, which corresponds to a distance of 211 m from the coordinate origin. As can be seen in the figure, the estimated value for the grounding resistance, obtained by correcting the field-measured values at any distance from the potential probe, is constant and has a value of $R_G = 0.007875 \Omega$, in full agreement with the theoretical value associated with the electrode.

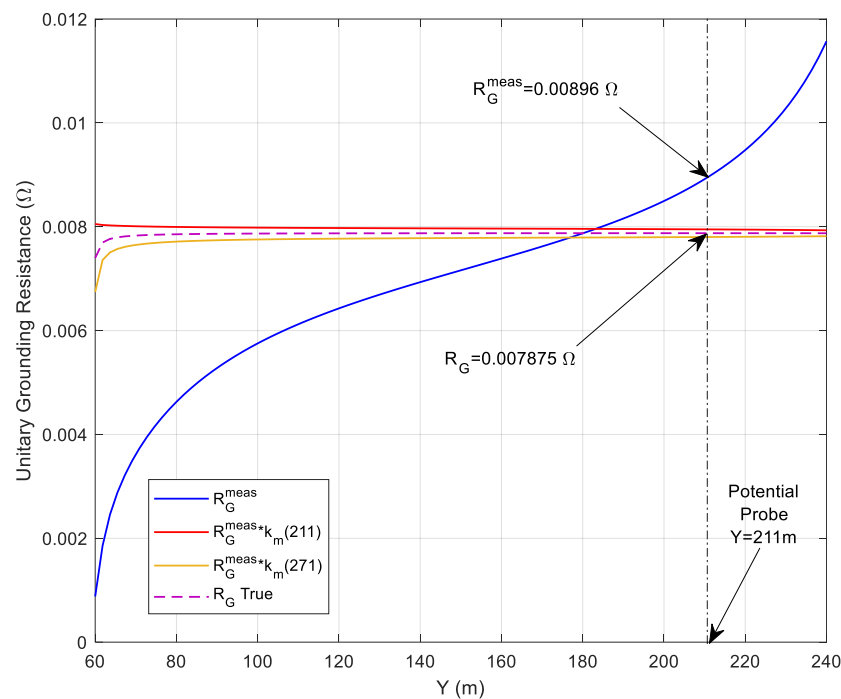


Figure 8. The different unitary resistances associated with the studied case, as discussed in the text.

4. Conclusions

Field measurement of the grounding resistance of large electrodes presents practical problems that are not easily solved. The commonly used three-pin method requires that the return electrode be sufficiently separated from the electrode to be measured so that it can be considered a current point, and the well-known 62% rule can be applied. Otherwise, the potential provided by the three-pin arrangement must be properly corrected. This paper proposes a simple method to correct the reading obtained from the direct measurement to obtain the actual grounding resistance. However, the value given by the method may not correspond to the theoretical value of the electrode due to various causes such as deterioration or interconnection with other groundings. In any case, the value given by the correction to the field measurements provides the correct value that would be obtained by applying the fall-of-potential method to a three-pin scheme with the auxiliary current electrode sufficiently far away, if this could be carried out. Such an auxiliary current electrode can be located at a relatively close distance to the electrode to be measured and the potential probe can be placed at any intermediate distance. The only requirement is that the electrode is known in all its physical characteristics as well as its location in the ground with known resistivity.

Author Contributions: Jorge Moreno (JM), Eduardo Faleiro (EF), Daniel Gracia (DG), Pascual Simon (PS), Gregorio Denche (GD) and Gabriel Asensio (GA). Conceptualization, JM, EF and PS.; methodology, JM, EF, DG and PS.; software, DG, GD and GA.; validation, JM, EF, PS and DG; formal analysis, JM, EF, DG and PS.; investigation, JM, EF and PS; resources, DG, PS, GD and GA; data curation, PS, GD and GA; writing—original draft preparation, JM, EF, PS, GD and GA; writing—review and editing, JM, EF, GD and GA; visualization, JM and EF.; supervision, JM and EF.; project administration, JM and EF. All authors have read and agreed to the published version of the manuscript.

Funding: This research received no external funding.

Institutional Review Board Statement: Not applicable.

Data Availability Statement: The data used in this paper are not public but has been kindly provided by the company *Union Fenosa Distribucion S.A.*

Acknowledgments: The authors would like to thank both the Department of Applied Mathematics and the IEEF Department of the *Escuela Técnica Superior de Ingeniería y Diseño Industrial (ETSIDI)* at the *Universidad Politécnica de Madrid (UPM)* for their support to the undertaking of the research summarized here. Furthermore, the authors appreciate the collaboration with the firm QUIBAC at Terrassa, Barcelona (Spain), for the technical support. Finally, we also would like to thank for the support provided by *Unión Fenosa Distribución S.A.* for allowing the use of data from electrical installations for scientific purposes to perform this work.

Conflicts of Interest: The authors declare no conflict of interest.

References

1. Lu Zhiweia, Zhang Zhaob. The Grounding Impedance Calculation of Large Steel Grounding Grid. 2012 International Conference on Future Electrical Power and Energy Systems. Energy Procedia 17 (2012) 157 – 163. DOI: 10.1016/j.egypro.2012.02.077.
2. Fabio Freschi, Massimo Mitolo, and Michele Tartaglia. An Effective Semianalytical Method for Simulating Grounding Grids. IEEE Transactions on Industry Applications, Vol. 49, No. 1, January/February 2013. DOI: 10.1109/TIA.2012.2229688
3. Jovan Trifunovic, Miomir B. Kostic. An Algorithm for Estimating the Grounding Resistance of Complex Grounding Systems Including Contact Resistance. IEEE Transactions on Industry Applications, Vol. 51, No. 6, November/December 2015. DOI: 10.1109/TIA.2015.2429644.
4. Gregorio Denche, Eduardo Faleiro, Gabriel Asensio, Jorge Moreno. An Estimator of the Resistance of Large Grounding Electrodes from Its Geometric Characterization. Appl. Sci. 2020, 10, 8162; DOI:10.3390/app10228162.
5. C. Korasli. Ground Resistance Measurement with Alternative Fall-of-Potential Method. 2005/2006 IEEE/PES Transmission and Distribution Conference and Exhibition. DOI: 10.1109/TDC.2006.1668628.
6. IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System, IEEE Std. 81-2012, 2012.
7. Jozsef Ladanyi, Balazs Smohai. Influence of Auxiliary Electrode Arrangements on Earth Resistance Measurement Using the Fall-of-Potential Method. 2013 4th International Youth Conference on Energy (IYCE). DOI: 10.1109/IYCE.2013.6604146.
8. V. Dimcev, B. Handjiski, P. Vrangalov, R. Sekerinska. Impedance measurement of grounding systems with alternative fall-of-potential method. Conference Record of the 2000 IEEE Industry Applications Conference. Thirty-Fifth IAS Annual Meeting and World Conference on Industrial Applications of Electrical Energy (Cat. No.00CH37129). DOI: 10.1109/IAS.2000.882627.
9. Felix Raul Alcantara. An Approximated Procedure to Find the Correct Measurement Point in the Fall-of-Potential Method. 2018 IEEE PES Transmission & Distribution Conference and Exhibition - Latin America (T&D-LA). DOI: 10.1109/TDC-LA.2018.8511738
10. M. Nassereddine, J. Rizk, M. Nagrial, A. Hellany. Substation earth grid measurement using the fall of potential method (FOP) for a limited test area. 2014 Australasian Universities Power Engineering Conference (AUPEC). DOI: 10.1109/AUPEC.2014.6966483
11. Cheng-Gang Wang, Takeshi Takasima, Tadahiro Sakuta, Yoshimasa Tsubota. Grounding resistance measurement using fall-of-potential method with potential probe located in opposite direction to the current probe. IEEE Transactions on Power Delivery, Vol. 13, No. 4, October 1998.
12. Huan Huang, Hualin Liu, Hong Luo, Hao Du, Yi Xing, Yexu Li, Farid P. Dawalibi, Haijun Zhou, Longhai Fu. Analysis of a Large Grounding System and Subsequent Field Test Validation Using the Fall of Potential Method. Energy and Power Engineering, 2013, 5, 1266-1272. DOI: 10.4236/epe.2013.54B240.
13. Tao Yuan, Yang Bai, Wenxia Sima, Chengchen Xian, Qingjun Peng, and Runsheng Guo. Grounding Resistance Measurement Method Based on the Fall of Potential Curve Test Near Current Electrode. IEEE Transactions on Power Delivery, Vol. 32, No. 4, August 2017. DOI: 10.1109/TPWRD.2016.2614519.
14. Pietro Colella, Enrico Pons, Riccardo Tommasini, Maria Luisa Di Silvestre, Eleonora Riva Sanseverino, Gaetano Zizzo. Fall of Potential Measurement of the Earth Resistance in Urban Environments: Accuracy Evaluation. IEEE Transactions on Industry Applications, Vol. 55, No. 3, May/June 2019. DOI: 10.1109/TIA.2019.2892680
15. SIST EN 50522:2022 - Earthing of power installations exceeding 1 kV a.c.

Disclaimer/Publisher's Note: The statements, opinions and data contained in all publications are solely those of the individual author(s) and contributor(s) and not of MDPI and/or the editor(s). MDPI and/or the editor(s) disclaim responsibility for any injury to people or property resulting from any ideas, methods, instructions or products referred to in the content.