

Article

Evaluation of Building Energy and Daylight Performance of Electrochromic Glazing for Optimal Control in Three Different Climate Zones

Myunghwan Oh ¹, Minsu Jang ^{1*}, Jaesik Moon ¹, Seungjun Roh ^{2,*}

¹ Building Envelope Technology Center, Energy & Environment Business Division, Korea Conformity Laboratories (KCL), 595-10, Pyengsin 1-ro, Daesan-eup, Seosan-si 31900, Chungnam, Korea; mhoh@kcl.re.kr (M. Oh); tankjang@kcl.re.kr (M. Jang); mwotlr@kcl.re.kr (J. Moon)

² School of Architecture & Architectural Engineering, Hanyang University, 55 Hanyangdaehak-ro, Sangrok-gu, Ansan-si 15588, Gyeonggi-do, Korea; roh.seungjun@gmail.com

* Correspondence: tankjang@kcl.re.kr; Tel.: +82-10-9401-4648, roh.seungjun@gmail.com; Tel.: +82-10-6350-5426

Abstract: Solar radiation is closely related to the energy buildings consume for cooling, heating, and lighting purposes. Glazing is the only material of the building envelope that transmits solar radiation and needs to be appropriately designed to reduce energy consumption. Currently, smart glass technology is being actively investigated and developed for effective solar radiation control. Among the various types of smart glass, electrochromic glazing is one of the most promising technologies, as it can adjust transmittance on its own, has a wider transmittance range in both the clear and darkened states, and consumes less electricity. Considering the importance of solar radiation adjustment in electrochromic glazing technology, this study attempted to develop an optimal control method for electrochromic glazing. Toward this goal, the solar radiation incident on vertical surfaces and outdoor temperature conditions were controlled in three regions with different climatic characteristics, and the annual cooling, heating, and lighting loads, discomfort glare, and interior illumination were analyzed. This approach enabled the optimal conditions with respect to visual comfort to be determined. Subsequently, the EDPI (Energy and daylight performance index) was used to optimize control conditions for each region, thereby producing integrated evaluations from results with different units and properties. The proposed control method will be utilized to develop a control algorithm and a control system to reduce building energy consumption.

Keywords: electrochromic glazing; building energy; daylight performance; optimal control; climate zone; EnergyPlus

1. Introduction

1.1. Research Background and Objective

Energy saving technology is being actively investigated and developed in the architectural industry, and regulations concerning building energy consumption tend to be strengthened in many countries around the world. Especially, because the building envelope is directly related to the amount of energy required for cooling, heating, and lighting, energy saving technologies have been investigated and developed in many relevant areas including insulation, airtightness, and solar radiation control.

In recent years, smart glass, of which the transmittance can be controlled to adjust the amount of solar radiation entering a building, has been actively developed. Various types of smart glass

products have been developed, including those with electrochromic (EC), thermochromic (TC), photochromic (PC), and polymer-dispersed liquid crystal (PDLC) coatings [1]. These smart glass products can control transmittance without the aid of shading devices such as blinds or rolling shades; instead, transmittance is easily adjusted by using electric signals [2].

Each type of smart glass that is being developed has its particular advantages and disadvantages. Electrochromic glazing has a wide transmittance range covering the entire solar spectrum in both the clear (transparent) and colored (darkened) states, and can be driven at a low voltage of 5 V or below [3]. In addition, if electricity supply is required only when the transmittance changes, it would not be necessary to supply electricity below the desired transmittance [4]. On the other hand, the disadvantage of EC glazing is that, when the transmittance changes, EC glazing has a slow response time that conventionally exceeds 10 minutes [5]. Thermochromic glazing changes its transmittance according to ambient temperature [6], and photochromic glazing varies the transmittance depending on ambient brightness [7]. Both thermochromic and photochromic windows can adjust their transmittance without power supply, which is a common advantage. However, automatic transmittance adjustment operates regardless of the user's intention, which is a disadvantage. Unlike EC glazing, PDLC glazing has a quick response time of less than 1 second and its transmittance range does not cover the entire solar spectrum. Thus, this type of glazing is advantageous for privacy protection because it can operate in both the transparent and translucent states [8]. Unlike EC glazing, PDLC glazing needs continuous power supply to maintain a transparent state [9].

Thus, among the above-mentioned smart glass products, EC glazing enables users to adjust transmittance over a wide range and does not need continuous power supply to maintain its state. Therefore, EC glazing is the most promising technology to control the solar radiation entering buildings. Studies on this type of smart glass are being actively conducted, and many prototypes have been released [10].

Among the studies on EC glazing, a study concerned with building energy saving showed that the application and operation of EC glazing in office buildings could reduce energy consumption by 20% [11]. Another study revealed that appropriate application of EC glazing reduced energy consumption more than the conventional glass products for buildings and the energy consumption could be reduced by over 54% in regions with a Mediterranean climate [12]. The impact of EC glazing on thermal and visual comfort was also examined [13]. Other studies analyzed the optical properties of EC glazing to derive the optimal transmittance according to the building types and weather conditions or simulated building energy consumption and daylight performance for analysis purposes [14,15]. In addition, a recent study considered a new type of EC glazing, which can selectively control radiation in the near-infrared range, i.e., it only plays a thermal role but is not visible [16]. Photovoltaic EC glazing is also being developed. Because photovoltaic panels produce power that is stored in a battery and can be used for tinting, no separate power supply is necessary and thus no energy is consumed during operation. Moreover, this type of smart EC glazing can be controlled by smartphones via a wireless IoT network, which provides users with advanced convenience as compared to traditional shading devices [17]. Slow response is one of the major disadvantages of EC glazing. To solve this problem, a metallic mesh with hardly visible electrodes is applied to the electrochromic coating to enhance the speed of electric flow and accelerate the response of EC glazing [18].

EC glazing can be utilized as solar radiation controller that easily adjusts its transmittance in response to electric signals. Accordingly, it is very important to minimize the consumption of cooling, heating, and lighting energy and optimize the indoor daylight conditions by appropriately adjusting the transmittance according to the external environment [19]. In this study, solar radiation and outdoor temperature were selected as the control variables to derive the optimal control conditions for EC glazing. We analyzed the extent to which the use of EC glazing to control transmittance affects the variation in the building load and daylight performance. The literature review presented in this section focused on previous studies that proposed optimal conditions for EC glazing control in the Korean climate [20]. Based on these studies, this study attempted to derive

the optimal conditions for controlling EC glazing in three climatic zones based on the solar radiation and temperature control conditions.

1.2. Research Method and Scope

The following methodology was used in this study: data relating to the optical properties of the clear and colored states of an EC glazing specimen (50 mm×50 mm), which was previously proposed, were used to derive the transmittance and reflectance data of double-glazing by using the LBNL Window 7.4 software. Transmittance and reflectance data thus obtained were input into EnergyPlus 8.5, which is a simulation tool for dynamic analysis of building energy. The energy and daylight performance of office buildings were analyzed under different control conditions of EC glazing.

The performance evaluation was conducted by selecting three cities that are located in different climatic zones: Moscow in Russia, Incheon in Korea, and Riyadh in Saudi Arabia. With respect to building energy consumption, 1) Moscow is mostly affected by winter, 2) Incheon is affected by both winter and summer, and 3) Riyadh is mostly affected by summer. Weather data available on the EnergyPlus website were used. The analysis was conducted by controlling the transmittance of EC glazing using the following coloring conditions: 1) 100 W/m² 2) 200 W/m², 3) 300 W/m², 4) 400 W/m², and 5) 500 W/m² according to the solar radiation and 6) 0 °C, 7) 5 °C, 8) 10 °C, 9) 15 °C, and 10) 20 °C according to the outdoor temperature. These two variables were selected to represent the external environment for EC glazing control to simplify the process with the aim of facilitating the commercialization of a control algorithm and hardware. These two control variables are the most closely related to the building envelope and the cooling, heating, and lighting loads. Finally, a method for achieving the maximum energy reduction using the control variables thus simplified was derived.

The total cooling, heating, and lighting loads, the annual amount of time during which the DGI (Daylight Glare Index) is below 22, and the annual amount of time during which the comfort interior illuminance (150~1500 lx) was maintained were analyzed for each of the weather conditions according to the control conditions. Finally, an integrated analysis of the building energy loads and daylight performance was carried out by using the EDPI (Energy and Daylight Performance Index), which was developed in previous studies, to derive the optimal control conditions for each climatic region. Figure 1 illustrates the overall flow of this study.

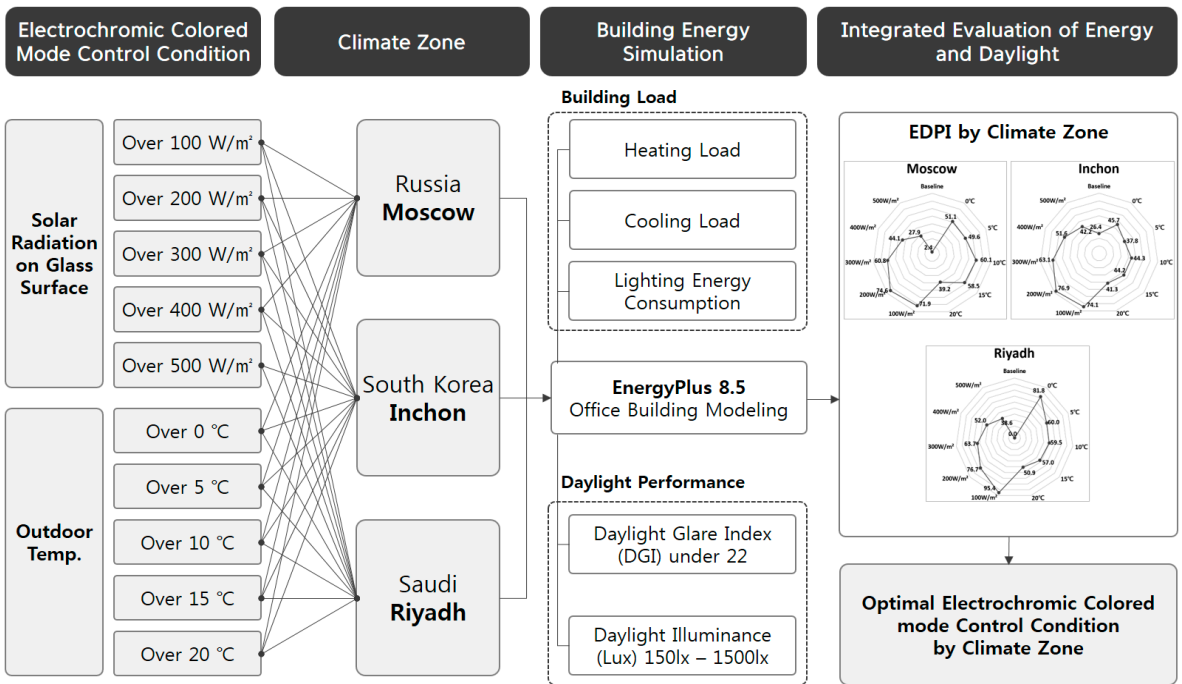


Figure 1. Research guideline and flowchart.

2. Optical Properties of Electrochromic Glazing

The optical properties data used in this study were obtained by analyzing a specimen of the EC glazing developed by the authors of this study. The total spectrum data of the optical properties of EC glazing formed the results of a previous study [20]. The EC glazing that was used in this study consisted of a transparent conductive object, an electrochromic layer, an ion storage layer, and electrolytes. TEC 10 of Pilkington was used as the transparent conductive object. Coatings of WO₃ (tungsten trioxide) 400 nm and NiW (nickel tungsten) 400 nm were sputtered onto the electrochromic layer and the ion storage layer, respectively. LiClO₄ gel-type electrolytes were used.

A spectrum analyzer (Optizen POP spectrometer) was used to analyze the optical properties. The transmittance and reflectance in the spectral wavelength range of 0.3~2.5 μm (0.005 μm intervals) were measured by applying voltage of 2 V and -2 V for 5 minutes to maintain the clear and colored states. The raw transmittance and reflectance data captured by the spectrum analyzer were imported into the LBNL (Lawrence Berkeley National Laboratory) Optic 5.1 program. In this way, the average spectral data pertaining to the solar transmittance, solar reflectance, visible transmittance, and visible reflectance were derived for EC single glazing, as presented in Table 1 [21]. As seen in the table, the solar transmittance (T_{sol}) of the EC glazing specimen could be controlled within the ranges of 48.1% and 6.5% in the clear and colored states, respectively. Visible transmittance (T_{vis}) proved to be adjustable within the ranges of 64.8% and 12% in the clear and colored states, respectively.

Because single glazing cannot be used for buildings, paired glass is required for heat insulation. Accordingly, the above data relating to EC single glazing were processed by the LBNL Window 7.4 program to construct the double glass for this study. The values computed for the optical properties and heat insulation are included in Table 2 [22]. These values were used to analyze the building energy and daylight performance according to the control variables (solar radiation and outdoor temperature) for each climatic region.

Table 1. Optical properties data of EC single glazing in the clear or colored state

Division		EC Glass (Clear)	EC Glass (Colored)
Thickness (mm)		3	3
Solar Transmittance	front	0.481	0.065
	back	0.481	0.065
Solar Reflectance	front	0.214	0.181
	back	0.190	0.168
Visible Transmittance	front	0.648	0.120
	back	0.648	0.120
Visible Reflectance	front	0.128	0.074
	back	0.111	0.062
Front and back side emissivity		0.840	0.840
Conductivity (W/mK)		1.000	1.000

Table 2. Optical and heat insulation properties of EC double glazing

Division	Electrochromic double glazing (6-mm EC Glass + 12-mm Air + 6-mm Low-e)	
	Clear mode	Darkened mode
U-value ¹	1.639	1.639
SHGC ²	0.408	0.127
Tvis ³	0.521	0.096

¹Thermal transmittance; ²Solar heat gain coefficient; ³Visible transmittance

3. Simulation Conditions

3.1. Overview of Analytical Simulation Model

This study used EnergyPlus 8.5, which was developed by the DOE (Department of Energy) of the US government, as a building energy simulation tool [23]. The building energy and daylight performance were analyzed by varying the EC glazing control conditions. EnergyPlus provides a switchable glazing component for controlling EC glazing, calculates the transmittance, reflectance, and absorption of solar radiation, and enables a detailed analysis of the building energy and load [24]. Additional advantages of EnergyPlus include the DGI (Daylight Glare Index) analysis component, which enables the analysis of glare as representing daylight performance, and a daylight sensor for analyzing interior luminance [25]. Figure 2 shows the analysis model for the simulation, which is a three-story office building. The model is divided into perimeter zones and a core zone. This study focused on the middle floor, and the southern, eastern, and western perimeter zones, which were affected by solar radiation, were analyzed. The analysis model had a floor area of 50 m × 50 m, a story height of 3 m, and a 60% window area ratio [20].

The envelope of the analysis model was constructed in accordance with the heat insulation requirements of the Building Energy Code (2016), and the electrochromic double glass derived by using the LBNL Windows tool described in Section 2, was used to represent the properties of glass. The temperatures of the analysis model were set to 20 °C and 26 °C in accordance with the indoor temperature requirements for calculating the capacities of cooling and heating systems in the Building Energy Code [26]. The Ideal Loads Air System, which is provide by EnergyPlus for analyzing loads by excluding as much interruption caused by system variables as possible was applied as the HVAC system [27]. As for internal heat gain, overhead lighting contributed 10.8 W/m², the peak occupancy was 22.3 m²/person, and an equipment contribution of 8.6 W/m² were applied according to the standards of ASHRAE Fundamentals (2009) [28]. The office schedule provided by the datasets of EnergyPlus was used as the schedule of internal heat gain contributed by the human body, lighting, and other devices. The outside airflow rate was set to 1.1 m³/m²h based on the operational rule of the Building Energy Efficiency Rating System.

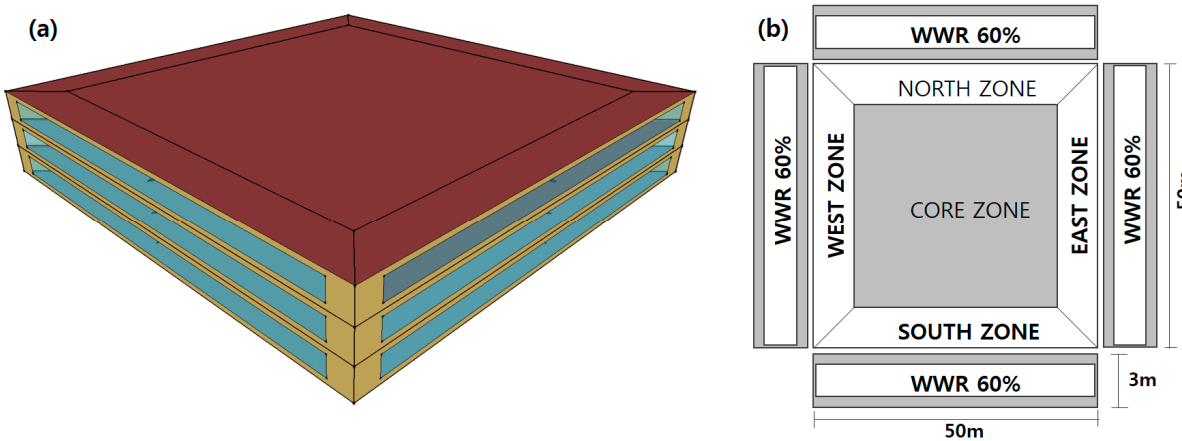


Figure 2. EnergyPlus Openstudio simulation model (a) and model explanation (b)[20].

To evaluate the performance in terms of lighting energy reduction, this study applied dimming control by taking 700 lx as the baseline of interior luminance when the building energy performance was analyzed by controlling EC glazing transmittance. EnergyPlus provides a component that enables three types of dimming control: stepwise, continuous, and continuous/off. Continuous dimming control was selected for this study. In other words, 100% lighting energy was consumed at an interior luminance of 0 lx, whereas no lighting energy was consumed at 700 lx. The interior luminance was continuously controlled from 0 to 700 lx.

191

Table 3. Exterior wall and glass properties of the analysis model

Division	Materials	Thermal & Optical Properties	
Exterior wall	200 mm concrete	U-value	
	155 t insulation	0.202 W/m ² K	
	19 mm gypsum board		
Exterior Floor	105 mm insulation	U-value	
	200 mm concrete	0.291 W/m ² K	
Exterior Roof	100 mm concrete	U-value	
	220 mm insulation	0.136 W/m ² K	
	Ceiling air space		
	Acoustic tile		
Glazing	26 mm double glazing (8 mm Electrochromic + 12 air + 6 mm low-e glass)	Clear	Darkened
		SHGC 0.408	SHGC 0.127
		Tvis 0.521	Tvis 0.096
		U-value 1.639	U-value 1.639

192 3.2 Climate zone and weather data

193 This study used the weather data available on the EnergyPlus website [29]. The weather data
194 pertaining to the following three cities were used as being representative of each characteristic
195 climate zone: 1) Moscow in Russia (cold climate), 2) Inchon (also written as Incheon) in Korea (hot
196 & cold climate), and 3) Riyadh in Saudi Arabia (hot climate).

197 Moscow in Russia is located in the continental climate zone. However, as compared to other
198 European cities of the same latitude, Moscow shows a larger variation in weather and has
199 especially cold weather in winter. The climatic conditions of Inchon in Korea are dominated by cold
200 continental anticyclone conditions during winter and hot and humid oceanic anticyclone conditions
201 during summer. Accordingly, because Inchon has a continental climate with an annual temperature
202 range of approximately 30 °C, both summer and winter occur in this city. Riyadh in Saudi Arabia
203 has a desert climate. The annual mean temperature is 32~38 °C and the highest temperature is
204 48 °C. The climate is hot and dry. Influenced by the continental climate, after sunset in summer,
205 evenings are cool and are often characterized by a strong northeasterly wind accompanied by
206 airborne dust and sand.

207 Table 4 presents the results of the analysis of the weather data from the EnergyPlus website for
208 each climate zone. The annual highest and lowest temperatures, respectively, were 30.5 °C and
209 −25.0 °C in Moscow, 32.6 °C and −11.7 °C in Inchon, and 45.6 °C and 4.0 °C in Riyadh. Thus, Riyadh
210 has the highest temperature and Moscow the lowest. The mean temperature was also the highest in
211 Riyadh, followed by Inchon and Moscow. The same ranking applied for solar radiation, that is,
212 Riyadh, Inchon, and Moscow. Based on these characteristics of the three climatic zones, the energy
213 and daylight performance of the EC glazing were analyzed according to the control conditions
214 presented in section 3.6.

215

Table 4. Results of comparative analysis of weather data for each climate zone

Division		Moscow	Inchon	Riyadh
Outdoor Temperature	Max	30.5	32.6	45.6
	Min	−25.0	−11.7	4.0
	Average	5.5	11.9	26.2
Direct Solar Radiation	Max	873.4	1013.7	935.3
	Min	-	-	-
	Average	74.6	86.7	258.5

3.6. Control conditions of EC glazing

This study attempted to derive a control method that could minimize the control variables of EC glazing and satisfy every condition regarding building energy and daylight performance. To simplify the control variables, this study restricted the range of external conditions to outdoor temperature and solar radiation.

First, EC glazing was controlled by varying the amount of solar isolation on the vertical surfaces: 1) 100 W/m² 2) 200 W/m², 3) 300 W/m², 4) 400 W/m², and 5) 500 W/m². When each respective solar radiation value is exceeded, the EC glazing is darkened; otherwise, it becomes clear.

Second, the EC glazing was controlled by varying the outdoor temperature as follows: 6) 0 °C, 7) 5 °C, 8) 10 °C, 9) 15 °C, and 10) 20 °C. In other words, the EC glazing is darkened when the temperature exceeds each specified temperature; otherwise, it becomes clear.

Ten conditions were set according to the solar radiation on the vertical surfaces and outdoor temperatures. The clear state of the EC glazing was maintained as the baseline. The EnergyPlus analysis model described in section 3.1 was utilized by applying the aforementioned ten control conditions and the energy and daylight performance were analyzed for each climate zone. The results are presented in section 4.

4. Results and Discussion

4.1. Analysis results of cooling, heating, and lighting load by varying the solar radiation

Glazing, which is the only part of a building that transmits solar radiation, is directly related to the cooling, heating, and lighting load. Especially, as the main function of smart glass is to control the solar radiation transmitted into indoor space, solar radiation is a control variable that needs to be preferentially considered when controlling EC glazing. Accordingly, solar radiation was set as a control variable and used to obtain the results presented in this section. For each climate zone represented by Moscow in Russia, Incheon in Korea, and Riyadh in Saudi Arabia, respectively, the EC glazing was controlled by varying the solar radiation to calculate the total annual cooling, heating, and lighting load. Then, the results of the calculation were analyzed and compared, and the optimal control condition for solar radiation was derived for each climate zone.

The solar radiation was measured on the vertical surfaces on which EC glazing was installed. When the amount of radiation exceeded the criteria set in section 3.6, the EC glazing was controlled to be colored. The cooling and heating loads were determined by using the Ideal Load Air System model of EnergyPlus 8.5 according to the control conditions for EC glazing. The loads necessary to achieve the set temperatures of 20 °C and 26 °C for cooling and heating, respectively, were calculated. This study applied lighting control to examine the lighting load required to maintain a suitable interior luminance, along with the cooling and heating loads. An interior luminance of 700 lx was set as the baseline, and continuous dimming control was adopted as the lighting control method to evaluate the impact of the lighting load for different transmittances of the EC glazing.

Table 5. Total annual cooling, heating, and lighting loads in Moscow according to solar radiation control

Load(kWh)	Baseline	100 W/m ²	200 W/m ²	300 W/m ²	400 W/m ²	500 W/m ²
Heating	32,729.3	35,059.3	34,730.3	34,335.5	33,930.0	33,592.6
Cooling	15,149.9	8,899.4	9,196.9	9,993.8	11,144.9	12,391.7
Lighting	6,424.0	9,853.9	7,273.5	6,841.2	6,610.2	6,504.2
Total	54,303.2	53,812.6	51,200.6	51,170.5	51,685.1	52,488.5

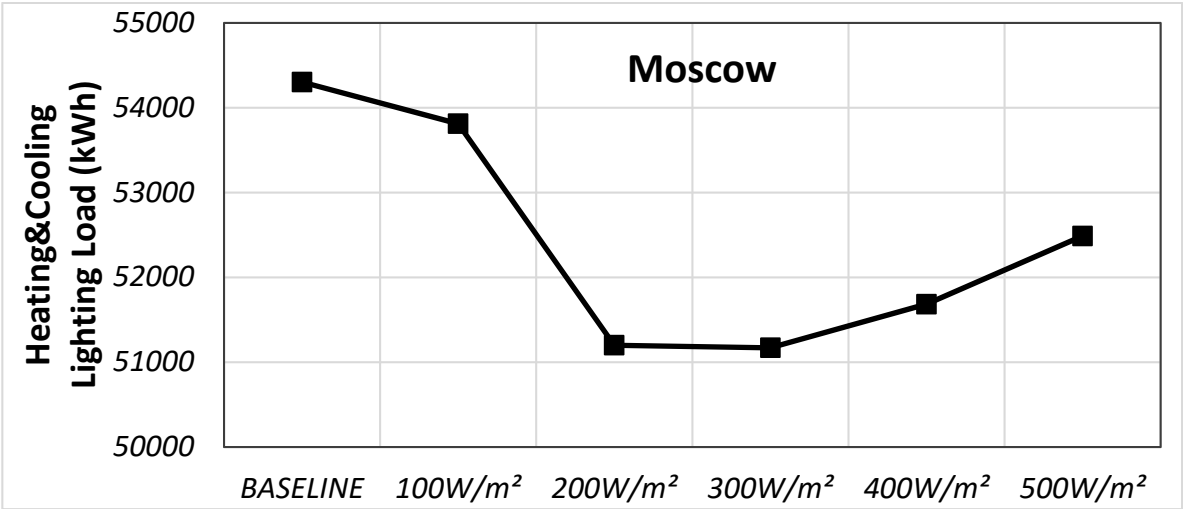


Figure 3. Total annual cooling, heating, and lighting loads in Moscow according to solar radiation control

Table 6. Total annual cooling, heating, and lighting loads in Incheon according to solar radiation control

Load(kWh)	Baseline	100 W/m²	200 W/m²	300 W/m²	400 W/m²	500 W/m²
Heating	10,966.1	13,915.5	13,547.1	13,153.4	12,548.4	12078.9
Cooling	24,608.2	18,912.5	19,410.1	20,301.6	21,261.5	22102.7
Lighting	4,770.1	9,099.3	5,786.6	5,274.8	4,993.0	4,855.9
Total	40,344.4	41,927.3	38,743.8	38,729.8	38,803.0	39,037.6

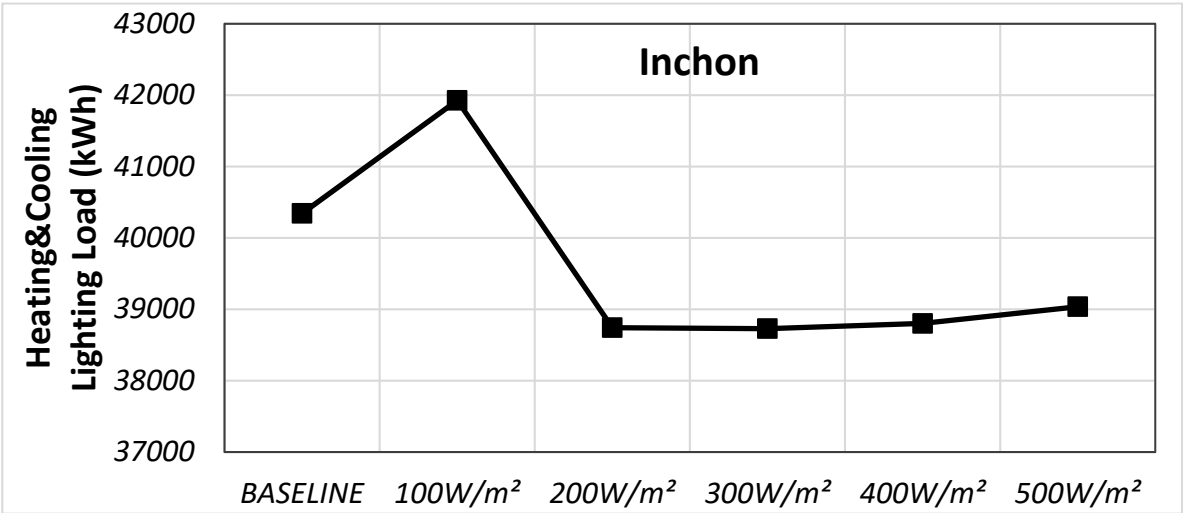


Figure 4. Total annual cooling, heating, and lighting loads in Incheon according to solar radiation control

Table 7. Total annual cooling, heating, and lighting loads in Riyadh according to solar radiation control

Load(kWh)	Baseline	100 W/m²	200 W/m²	300 W/m²	400 W/m²	500 W/m²
Heating	0.0	0.9	0.6	0.4	0.2	0.0
Cooling	86,239.4	62,334.7	63,139.6	64,756.4	66,827.2	69,896.1
Lighting	4,040.4	9,727.1	5,987.0	5,232.9	4,782.3	4,461.2
Total	90,279.8	72,062.7	67,127.2	69,989.6	71,609.6	74,357.4

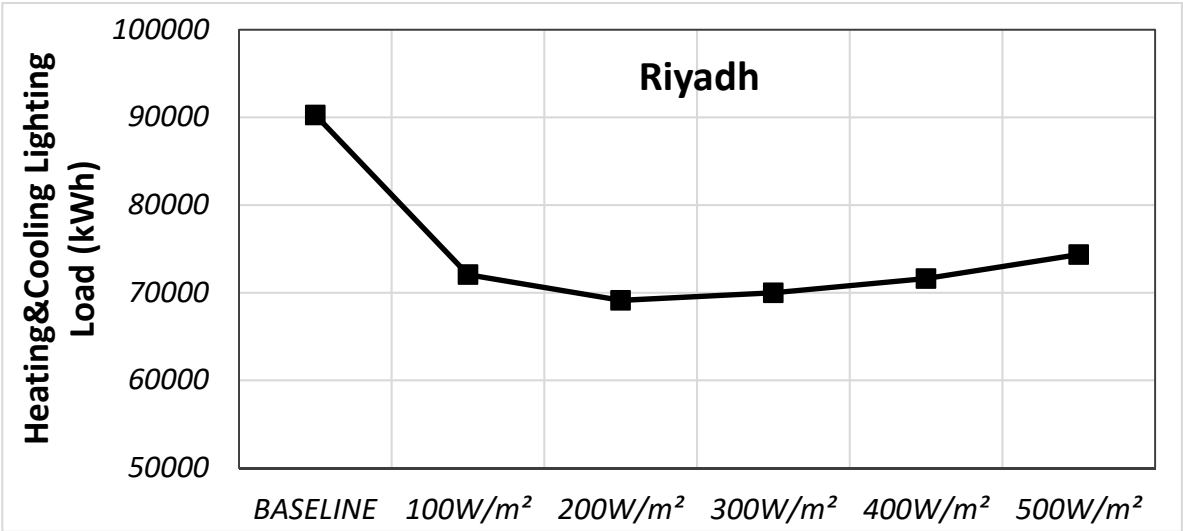


Figure 5. Total annual cooling, heating, and lighting loads in Riyadh according to solar radiation control

First, as shown in Table 5 and Figure 3, the analysis results for Moscow, Russia, revealed that, when EC glazing was controlled according to the solar radiation, the annual load was reduced under all control conditions relative to the baseline. In Moscow, among the control conditions for EC glazing, the annual load was decreased by the smallest amount at 100 W/m² and decreased by the largest amount at 300 W/m². The total annual load of Moscow was mostly affected by the difference in cooling load, which was related to the extent to which the EC glazing was controlled. Figure 6 shows the monthly loads for Moscow. Clearly, controlling the EC glazing according to the solar radiation has a larger effect on the cooling load in summer than in winter.

Second, the analysis results for Incheon, Korea are presented in Table 6 and Figure 4. These results indicate that, except for 100 W/m², the annual load decreased under all the control conditions for EC glazing, with the greatest decrease at 300 W/m². When solar radiation of 100 W/m² was used, the annual load increased. This was explained as follows: the small amount of solar radiation transmitted at 100 W/m² resulted in a high heating load during winter, as shown in Figure 7, and required the lighting load during summer to be high because of the low interior luminance.

Third, as shown in Table 7 and Figure 5, the analysis results for Riyadh, Saudi Arabia, revealed that the annual load was lower than the baseline under all control conditions for EC glazing, with the largest decrease in load at 200 W/m². Figure 8 shows that, unlike Moscow and Incheon, the annual load of Riyadh decreased. This is attributable to the cooling-based weather patterns of Riyadh. In other words, the cooling load could be considerably reduced by shading, which resulted in the observed marked decrease in the total annual load.

An analysis of the variations in the total annual load as a result of controlling the EC glazing by varying the amount of solar radiation revealed that Moscow, Incheon, and Riyadh had the smallest loads at 300 W/m², 300 W/m², and 200 W/m², respectively. In particular, Riyadh showed a decrease in the annual load of as much as 23.4% at 200 W/m², which was the most remarkable effect. Incheon and Moscow showed decreases of 4.0% and 5.8%, respectively, in the annual load, at 300 W/m². Accordingly, EC glazing was especially effective in Riyadh and a similar region, both of which show a cooling-based weather pattern. Our analysis of the results for the three cities suggested that setting the EC glazing to be colored in the range 200–300 W/m² with respect to the total annual load would be adequate.

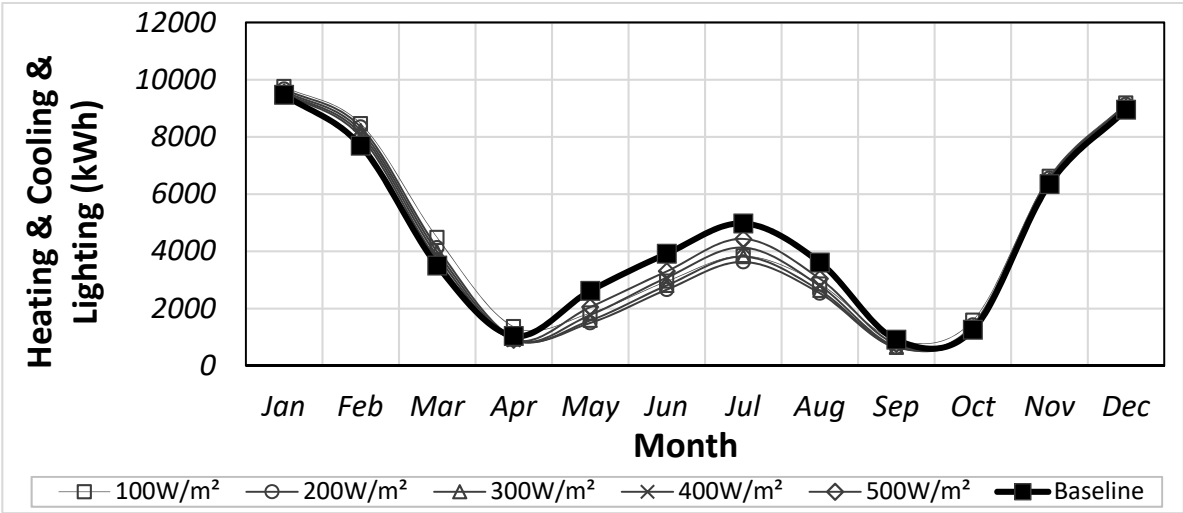


Figure 6. Total monthly cooling, heating, and lighting loads in Moscow according to solar radiation control

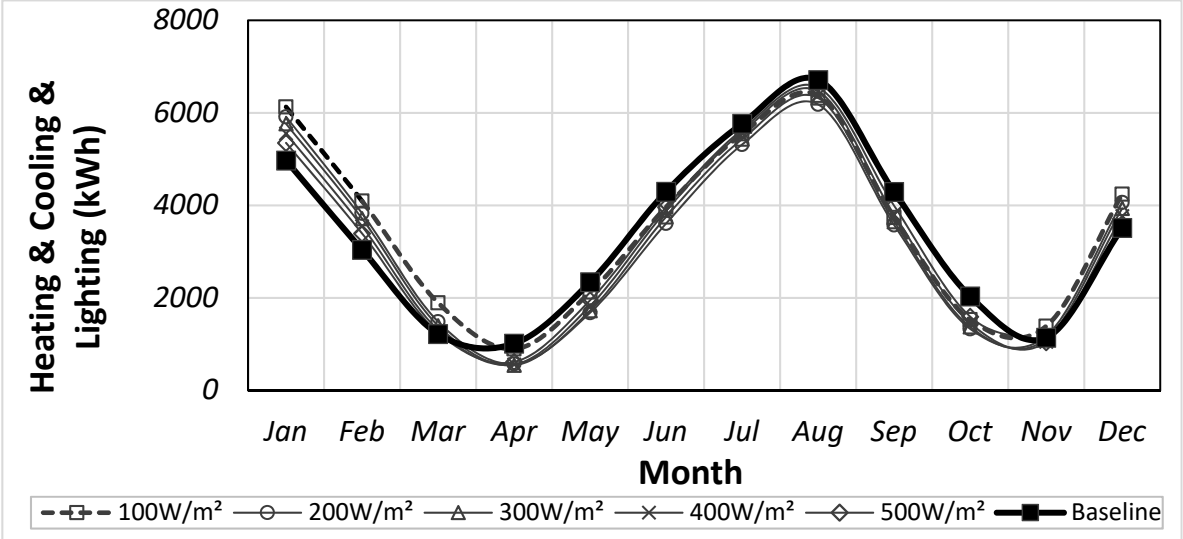


Figure 7. Total monthly cooling, heating and lighting loads in Incheon according to solar radiation control

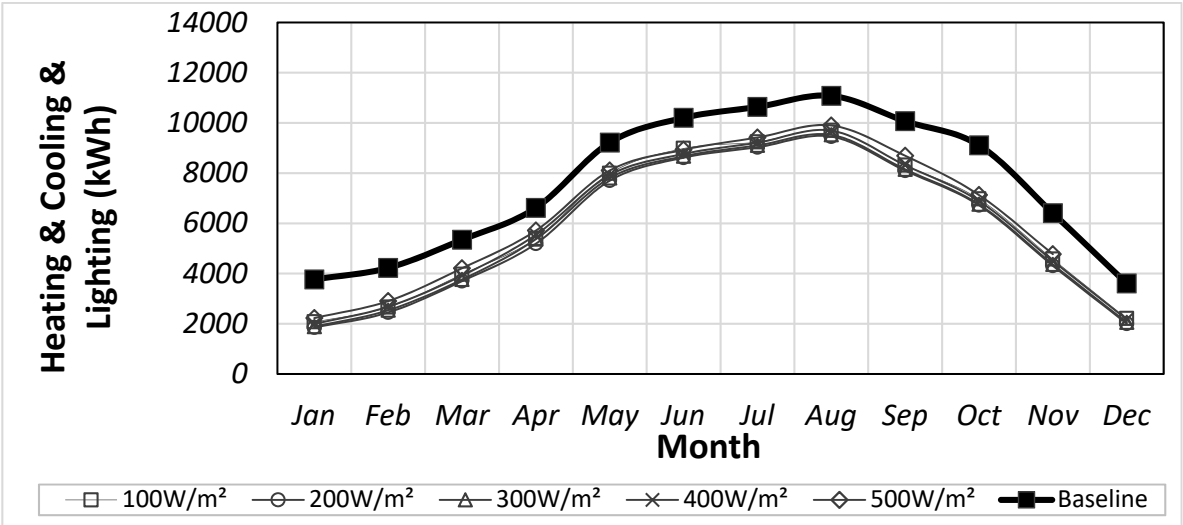


Figure 8. Total monthly cooling, heating, and lighting loads in Riyadh according to solar radiation control

4.2. Analysis of daylight performance according to solar radiation control

Apart from decreasing the cooling, heating, and lighting load, the analysis of which is presented in section 4.1, the smart glass for solar radiation control also needs to prevent glare and ensure an appropriate interior luminance from the users' viewpoint. Therefore, the DGI related to glare and interior luminance was analyzed according to EC glazing control by performing an EnergyPlus 4.8 simulation.

DGI was proposed by Hopkinson. It is recommended that an office building has a DGI value of 22 or below [30]. The DGI was investigated by analyzing the percentage of time during which the DGI value was 22 or below for the total annual time of 8,760 hours by using the EnergyPlus 8.4 simulation tool. The appropriate luminance range of 150–1500 lx, as specified by KS (Korean Industrial Standard) A 3011 for office buildings, was adopted [31]. The percentage of time during which the appropriate interior luminance range of 150–1500 lx was satisfied for the total annual time of 8,760 hours was calculated. Analysis of the interior luminance excluded all forms of artificial lighting and only natural light was considered.

Table 8 and Figure 9 and 10 show the analysis results for DGI and interior luminance. The DGI results revealed that all the solar radiation control conditions provided excellent performance relative to the baseline. For Moscow, Inchon, and Riyadh 100 W/m² was optimal. The higher the amount of solar radiation, the more disadvantageous the condition was with respect to DGI.

The results obtained for the interior luminance showed that, irrespective of the amount of solar radiation, EC glazing delivered excellent performance relative to the baseline. Similar to the result of the DGI analysis, the optimal amount of solar radiation for Moscow, Inchon, and Riyadh was 100 W/m².

The best performance was attained for both the DGI and interior luminance when setting the solar radiation to 100 W/m². An examination of the 100 W/m² with respect to the cooling, heating, and lighting load discussed in section 4.1, showed a smaller decrease in the load for Moscow than under other conditions, an increase in the load above the baseline for Inchon, and no improvement in the case of Riyadh. Accordingly, the cooling, heating, and lighting loads and the daylight performance need to be comprehensively evaluated.

Table 8. Percentage of DGI values below 22 and comfort illuminance according to solar radiation control

Division	DGI below 22 (%)			Daylight Illuminance 150–1500 lx (%)		
	Moscow	Inchon	Riyadh	Moscow	Inchon	Riyadh
Baseline	67.9	70.8	63.5	49.7	48.0	42.1
100 W/m ²	89.6	92.2	91.7	76.7	77.1	78.1
200 W/m ²	83.5	86.4	80.9	67.8	66.2	73.0
300 W/m ²	78.0	80.5	74.2	60.7	59.1	65.8
400 W/m ²	73.6	76.1	70.4	55.6	53.8	59.5
500 W/m ²	70.5	73.1	67.4	52.2	50.0	52.5

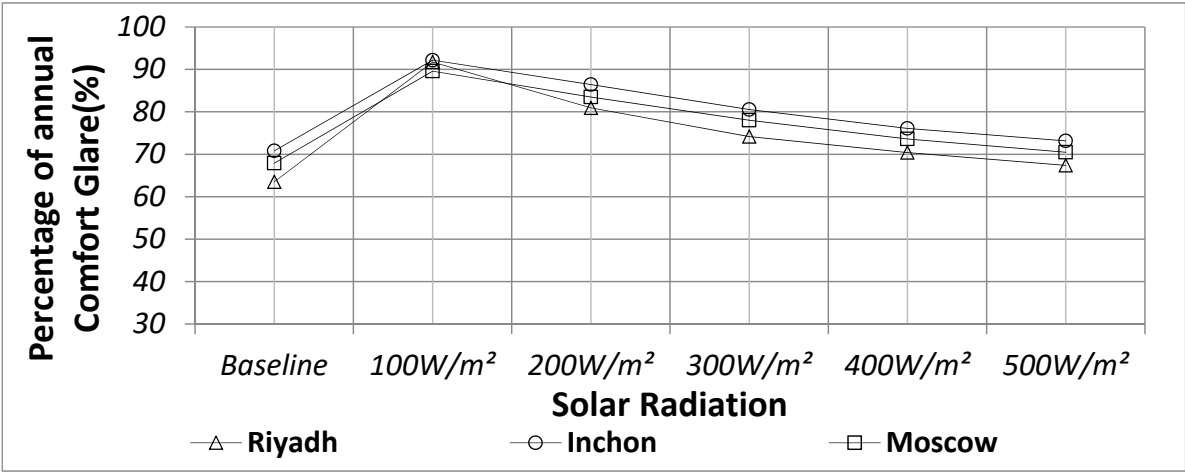


Figure 9. Percentage of annual DGI below 22 according to solar radiation control

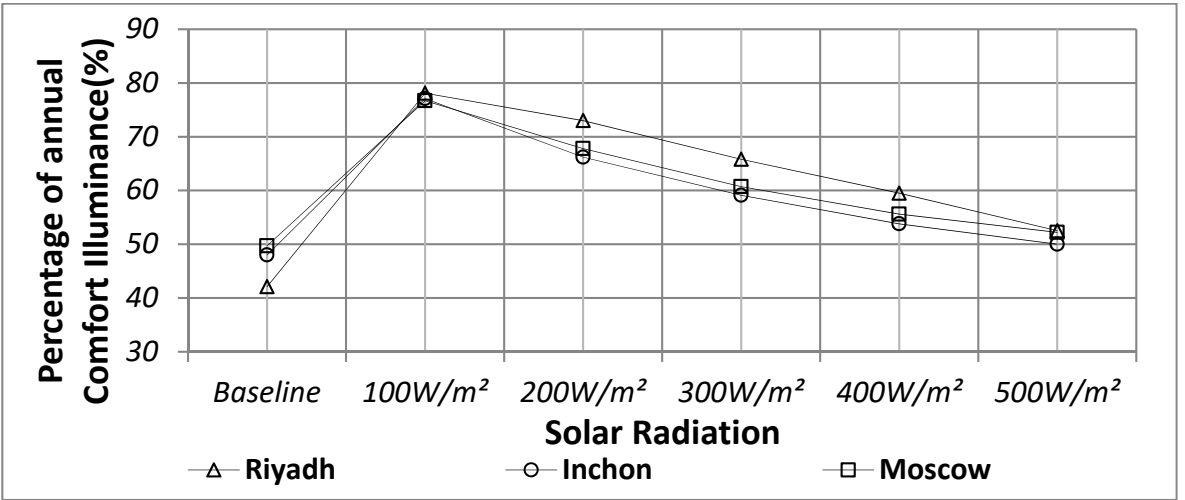


Figure 10. Percentage of annual comfort illuminance according to solar radiation control

4.3. Analysis results for cooling, heating and lighting load according to temperature control

This section presents an analysis of the difference in the sum of the annual cooling, heating, and lighting loads for each climate zone, that is, Moscow, Incheon, and Riyadh. Similar to solar radiation, outdoor temperature is another representative factor that directly affects the energy requirements of a building. If the outdoor temperature increases, the interior cooling load also increases. When the EC glazing is colored to block solar radiation and thus to reduce the cooling load, the building energy requirement is reduced. This is the goal of temperature control. However, the outdoor temperature conditions under which the EC glazing needs to be colored to prevent solar radiation from entering in each climate zone remain unclear. Accordingly, this study assumed five temperature conditions of 0 °C, 5 °C, 10 °C, 15 °C, and 20 °C and derived optimal control temperatures by using an exhaustive search method.

Table 9. Total annual cooling, heating and lighting loads in Moscow as a function of temperature control

Load(kWh)	Baseline	0 °C	5 °C	10 °C	15 °C	20 °C
Heating	32,729.3	33,391.8	33,062.1	32,784.4	32,734.9	32,730.2
Cooling	15,149.9	8,870.6	8,893.6	9,131.0	10,060.2	12,293.6
Lighting	6,424.0	11,600.8	10,517.3	9,431.9	8,368.7	7,202.4
Total	54,303.2	53,863.2	52,473.1	51,347.2	51,163.8	52,226.2

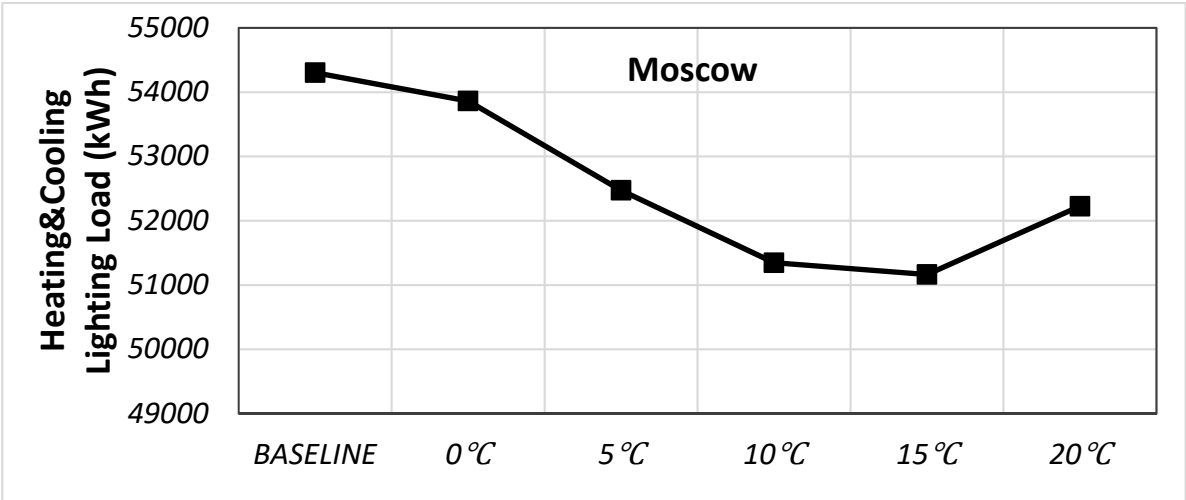


Figure 11. Total annual cooling, heating, and lighting loads in Moscow according as a function of temperature control

Table 10. Total annual cooling, heating, and lighting loads in Incheon as a function of temperature control

Load(kWh)	Baseline	0 °C	5 °C	10 °C	15 °C	20 °C
Heating	10966.1	12080.7	11443.0	11035.0	10967.4	10966.6
Cooling	24608.2	19372.0	19398.2	19648.8	20351.8	21599.7
Lighting	4770.1	11386.2	10625.3	9577.9	8641.7	7306.9
Total	40344.4	42838.9	41466.4	40261.6	39960.9	39873.2

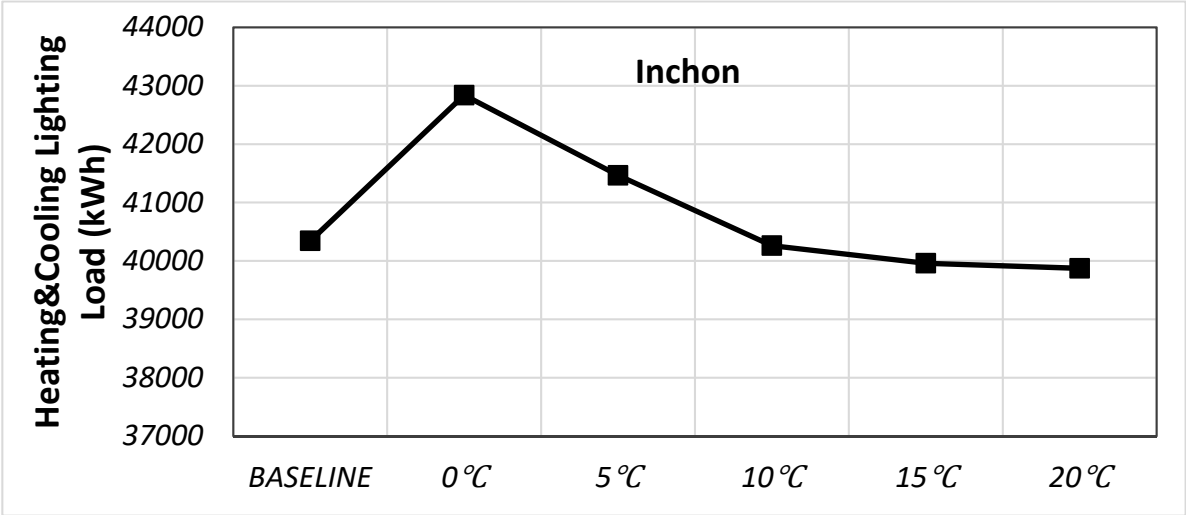


Figure 12. Total annual cooling, heating, and lighting loads in Incheon as a function of temperature control

Table 11. Total annual cooling, heating, and lighting loads in Riyadh as a function of temperature control

Load(kWh)	Baseline	0 °C	5 °C	10 °C	15 °C	20 °C
Heating	0.0	1.1	1.1	0.3	0.0	0.0
Cooling	86,239.4	62,429.1	62,439.8	62,866.7	64,477.8	67,819.5
Lighting	4,040.4	10,899.0	10,897.0	10,828.1	10,333.8	9,511.3
Total	90,279.8	73,329.1	73,337.9	73,695.1	74,811.6	77,330.8

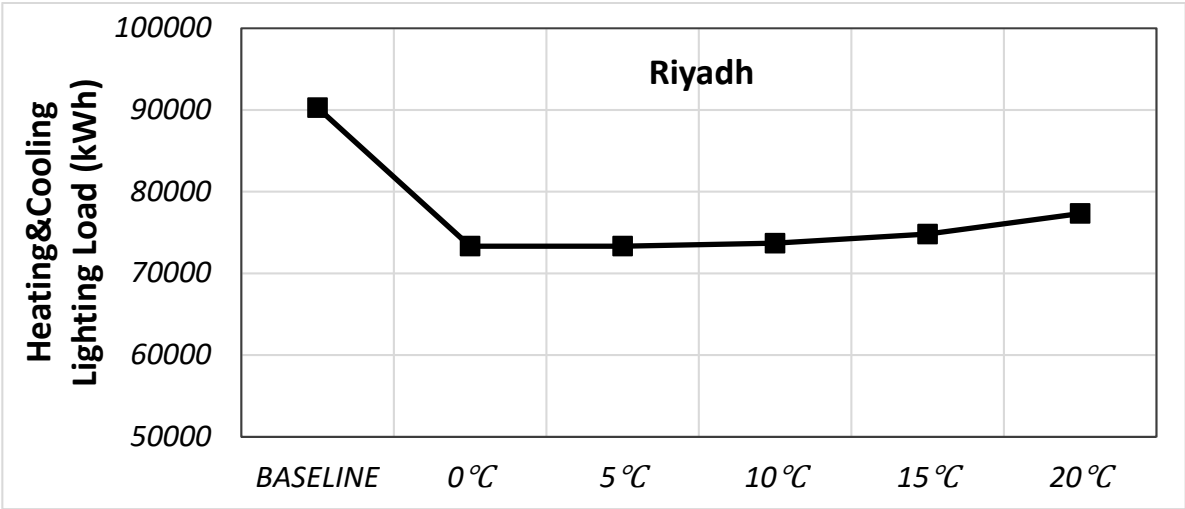


Figure 13. Total annual cooling, heating, and lighting loads in Riyadh as a function of temperature control

The analysis results are as follows. First, as shown in Table 9 and Figure 11 for Moscow, using the EC glazing for temperature control could reduce the annual load under every condition relative to the baseline. Controlling the EC glazing at 0 °C resulted in the smallest decrease in the annual load, whereas the largest decrease in the annual load was obtained at 15 °C. Similar to solar radiation control, the total annual load for Moscow was considerably affected by the difference in the cooling load according to EC glazing control. Figure 14 shows the monthly loads for Moscow. As in the case of the solar radiation control, temperature control for EC glazing had a larger effect on the cooling load.

Second, the results of the analysis for Incheon, Korea, are provided in Table 10 and Figure 12. The annual load was increased above the baseline at 0 °C and 5 °C but was decreased below the baseline at 15 °C and 20 °C. Among those temperature control conditions, the decrease in the annual load was largest at 20 °C. On the other hand, the annual load was increased when the temperature was set to 0 °C and 5 °C. This is because the smallest amount of solar radiation was received at 0 °C and 5 °C, which increased both the heating and lighting loads. Accordingly, as shown in Figure 15, the monthly load increased during winter. Similar load patterns are displayed all year round both under the baseline condition and the other temperature conditions including 10 °C, 15 °C, and 20 °C. As the winter temperatures of Incheon remain below 10 °C, EC glazing always maintains the transparent state, thereby producing a similar load to the baseline. During summer, solar radiation is prevented from entering and the cooling load is reduced, but the impact of the increase in the lighting load is greater, which offsets the decrease in the cooling load.

Third, the results of the analysis for Riyadh, Saudi Arabia, are presented in Table 11 and Figure 13. The total annual load is lower than the baseline under every temperature condition for EC glazing. The decrease in the load is the largest at 0 °C. Figure 16 illustrates that, unlike Moscow and Incheon, the total annual load for Riyadh decreased. This is because the weather patterns of Riyadh emphasized the need for cooling operations and thus the cooling load was reduced by preventing solar radiation from entering, which could lower the total annual load.

The above-mentioned results regarding temperature control for EC glazing were examined more comprehensively. This examination showed that Moscow, Incheon, and Riyadh have the smallest load at 15 °C, 20 °C, and 0 °C, respectively. In particular, Riyadh achieved a decrease of 18.8% in the annual load at 0 °C, which was the best performance. The annual load for Incheon decreased by 1.2% at 20 °C, whereas for Moscow the load decreased by 5.8% at 15 °C. Using the solar radiation condition for which the best performance was obtained in section 4.1, the percentage by which the annual load decreased was 23.4% for Moscow, 4.0% for Incheon, and 5.8% for Riyadh. Thus, solar radiation control for EC glazing is more effective than temperature control for reducing the cooling, heating, and lighting load in all the target cities except Riyadh.

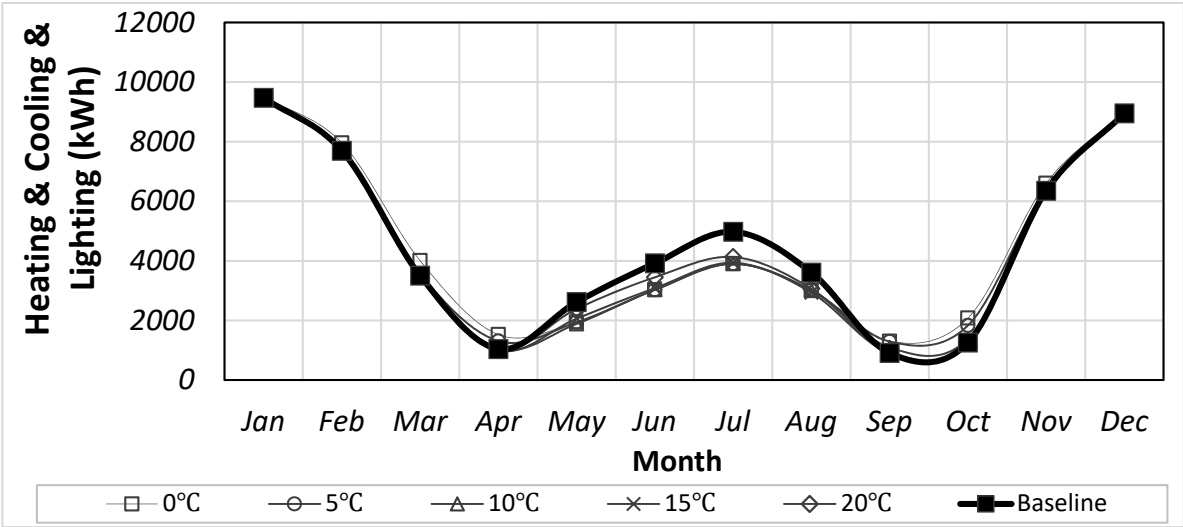


Figure 14. Total monthly cooling, heating, and lighting loads according to temperature control in Moscow

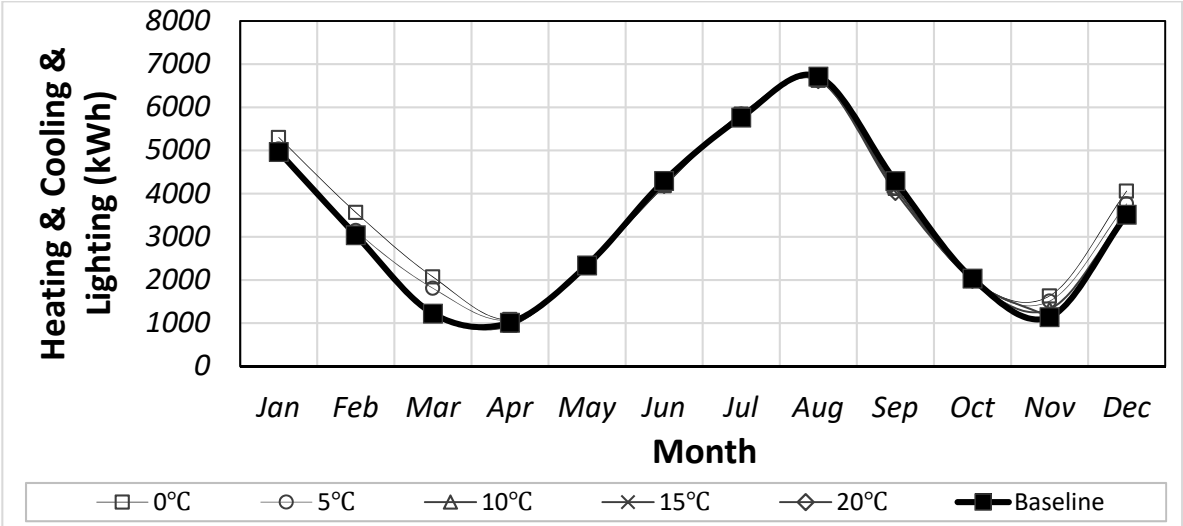


Figure 15. Total monthly cooling, heating, and lighting loads according to temperature control in Incheon

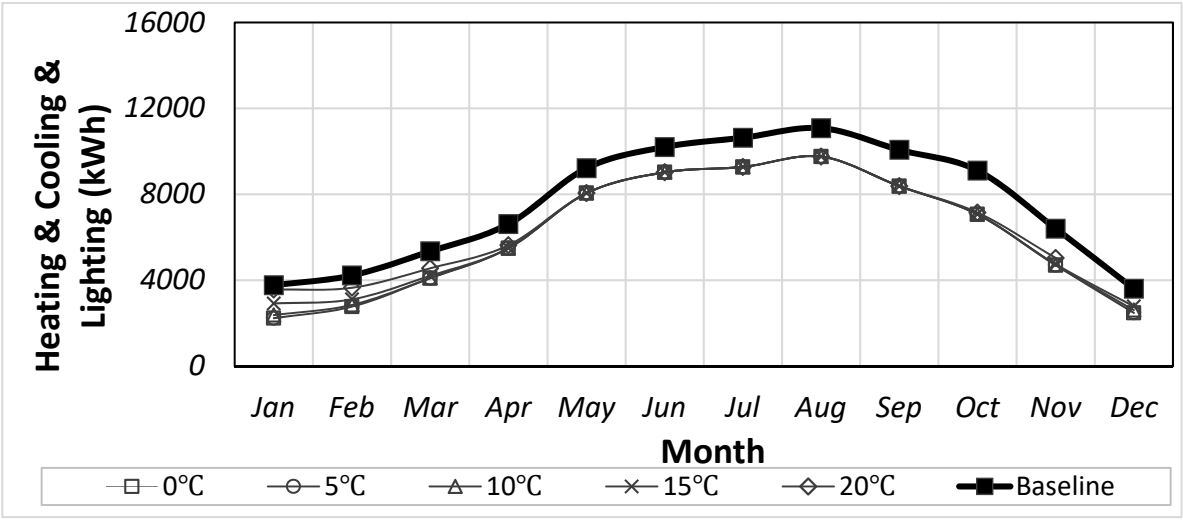


Figure 16. Total monthly cooling, heating, and lighting loads according to temperature control in Riyadh

4.4. Analysis results for daylight performance according to temperature control

Table 12 and Figure 17 and 18 provide the results of the analysis of the DGI and interior illuminance. The DGI result shows that all the temperature conditions for EC glazing outperformed the baseline. The best performance was obtained when the EC glazing was controlled at 0 °C in Moscow, Inchon, and Riyadh. The higher the temperature, the more disadvantageous the condition was with respect to DGI. However, the result obtained for interior illuminance deviated from that of DGI. The performance with respect to interior illuminance is optimal at 10 °C, 5 °C, and 10 °C, for Moscow, Inchon, and Riyadh, respectively.

Analysis of the cooling, heating, and lighting loads, presented in section 4.3, revealed that the performance for Moscow, Inchon, and Riyadh was optimal at 15 °C, 20 °C, and 0 °C, respectively. However, with respect to DGI, all three cities performed the best at 0 °C. In addition, with respect to interior luminance, Moscow, Inchon, and Riyadh displayed the best performance at 10 °C, 5 °C, and 10 °C, respectively.

As in the case of solar radiation control, comprehensive evaluation and analysis are necessary to derive an optimal control condition with respect to both the energy and lighting environments. Accordingly, in section 4.5, the EDPI is utilized to comprehensively analyze the total annual cooling, heating, and lighting loads, DGI, and interior luminance.

Table 12. Percentage of DGI values below 22 and comfort luminance range according to temperature control

Division	DGI under 22 (%)			Daylight Illuminance 150–1500 lx (%)		
	Moscow	Inchon	Riyadh	Moscow	Inchon	Riyadh
Baseline	67.9	70.8	63.5	49.7	48.0	42.1
0 °C	88.6	89.9	91.8	55.1	54.4	64.2
5 °C	87.5	87.9	91.8	58.2	55.2	64.3
10 °C	84.9	84.9	91.7	59.2	54.8	64.6
15 °C	81.2	82.3	90.6	58.6	54.7	64.1
20 °C	75.2	78.6	87.0	56.0	53.7	63.8

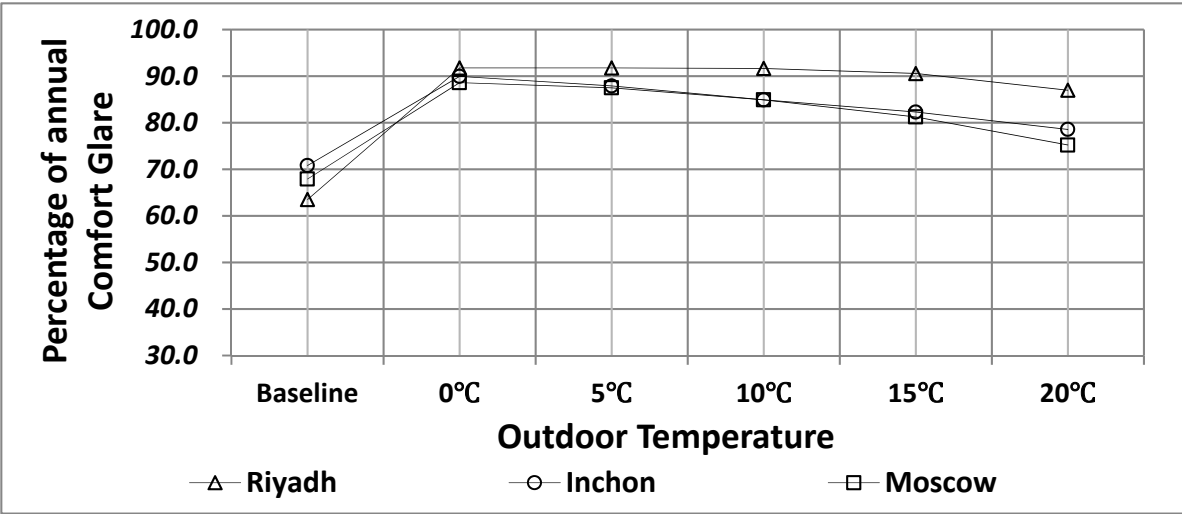


Figure 17. Percentage of annual DGI values below 22 according to temperature control

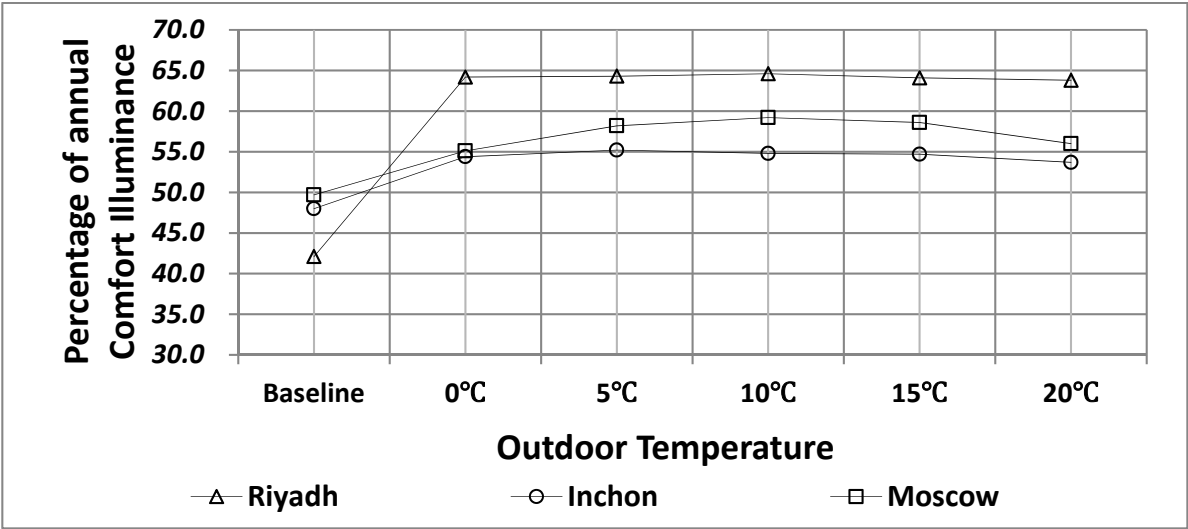


Figure 18. Percentage of annual comfort illuminance according to temperature control

4.5. Derivation of optimal control conditions by comprehensively considering energy and daylight environment

The daylight performance was analyzed with respect to the cooling, heating, and lighting load, DGI, and interior illuminance in sections 4.1 to 4.4. The results clarified the advantages and disadvantages in terms of the control conditions of EC glazing for each climate zone. However, the optimal characteristics identified thus far are varied and this prevented an optimal control method for each climate zone to be determined. Accordingly, a method for comprehensive evaluation is required. In this section, the EDPI (Integrated Energy and Daylight Performance Index), which was developed in a previous study, is used to comprehensively evaluate the performance with respect to energy and the daylight environment [19]. As shown in Eq. 1, the EDPI evaluates performance by obtaining percentiles from the comparison of the actual maximum and minimum values for each component of the sum of the annual cooling, heating and lighting loads, the percentage of annual DGI values below 22, and the percentage of annual interior comfort luminance.

For example, in the case of Moscow, if the percentage of the annual DGI values below 22 under the different temperature conditions is calculated by using $EPDI_{ij}$, the value of component i indicates the percentage of DGI values below 22 under the different temperature and solar radiation conditions, and condition j represents every temperature and solar radiation condition. Considering the percentage of annual DGI values below 22 in Table 12, when the score for the control condition of 5 °C in Moscow is calculated, the Actual X_{ij} value is 87.5%, Minimum X_{ij} value is 67.9%, and Maximum X_{ij} value is 89.6% (actual values when the solar radiation is 100 W/m²). Substituting these values into Eq. 1 yields a result of 90.4. Based on Table 13, the percentage $EPDI_{ij}$ of annual DGI values below 22 for the optimal temperature condition in Moscow is 90.4.

Accordingly, the $EPDI_{ij}$ of the sum of the annual cooling, heating, and lighting loads, the percentage of annual DGI values below 22, and that of annual comfort luminance is derived for each control condition for EC glazing for each climate zone. Then, an integrated performance evaluation becomes possible by calculating the mean value of data thus derived.

$$EDPI_{ij} = \frac{Actual\ X_{ij}\ value - Minimum\ X_{ij}\ value}{Maximum\ X_{ij}\ value - Minimum\ X_{ij}\ value} \times 100 \tag{1}$$

The results of the EDPI analysis were as follows. First, in the case of Moscow, solar radiation of 200 W/m² proved to be the best condition. Based on the EDPI, among the ten conditions, this condition ranked second in terms of decreasing the annual load. As regards the daylight environment, the condition of 200 W/m² was ranked fourth in preventing discomfort glare and second in the percentage of annual comfort luminance. Although the condition of 200 W/m² did not

record the best score in terms of the load and daylight environment, it proved to be the best condition by comprehensively considering complex factors and combining high scores.

In the case of Incheon, as for Moscow, the solar radiation of 200 W/m² was the best condition. Based on the EDPI, solar radiation of 200 W/m² was ranked second in all the following categories: the cooling, heating, and lighting loads, the percentage of annual DGI values below 22, and the percentage of annual comfort luminance. The condition of 100 W/m² produced the best result, that is, 100 points regarding the daylight environment but was ranked ninth regarding the annual load among the ten conditions. The condition of 300 W/m² was ranked first regarding the annual load but had a low ranking with respect to the daylight environment. Accordingly, by considering the complex factors comprehensively and by combining the high scores, solar radiation of 200 W/m² was determined to ensure the best performance in Incheon.


Finally, in the case of Riyadh, unlike Moscow and Incheon, solar radiation of 100 W/m² proved to be optimal. This solar radiation condition ranked fourth among the ten conditions in terms of decreasing the annual load. With respect to the daylight environment, solar radiation of 100 W/m² ranked first both with respect to the percentage of annual DGI values below 22 and the percentage of annual comfort luminance. The second best solar radiation, 200 W/m², ranked first regarding the annual load. With respect to the daylight environment, solar radiation of 200 W/m² ranked fifth in the percentage of annual DGI values below 22 and second in the percentage of annual comfort luminance. Although solar radiation 200 W/m² yielded good results, the comprehensive evaluation showed that solar radiation of 100 W/m² scored 95.4 points whereas for 200 W/m² the score was 82.5 points. This indicates that solar radiation of 100 W/m² is the optimal control condition for Riyadh.

In summary, solar radiation of 200 W/m² was optimal for Moscow and Incheon, whereas 100 W/m² provided the best results for Riyadh.

As for the top 30% of the conditions in each climate zone, solar radiation of 200 W/m² (EDPI 79.2) was the best for Moscow, followed by 100 W/m² (EDPI 71.9) and temperature of 10 °C (EDPI 69.3). For Incheon, solar radiation of 200 W/m² (EDPI 78.4) was the best condition, followed by 100 W/m² (EDPI 74.1) and 300 W/m² (EDPI 61.2). For Riyadh, solar radiation of 100 W/m² (EDPI 95.4) was the best condition, followed by 200 W/m² (EDPI 82.5) and temperature of 5 °C (EDPI 80.6). Thus, in each one of the climate zones we analyzed, the solar radiation on a vertical surface was a more effective variable in controlling EC glazing than the outdoor temperature.

Table 13. Integrated evaluation of energy and daylight performance using EDPI

Division	EDPI				EDPI Chart
	DGI below 22	Lux 150–1500 lx	Total Load (kWh)	Average	
Moscow	Baseline	0.0	0.0	0.0	
	100 W/m ²	100.0	100.0	15.6	
	200 W/m ²	71.8	67.0	98.8	
	300 W/m ²	46.8	40.7	99.8	
	400 W/m ²	26.3	21.9	83.4	
	500 W/m ²	11.9	9.3	57.8	
	0 °C	95.5	20.0	14.0	
	5 °C	90.4	31.5	58.3	
	10 °C	78.5	35.2	94.2	
	15 °C	61.5	33.0	100.0	
	20 °C	33.7	23.3	66.2	

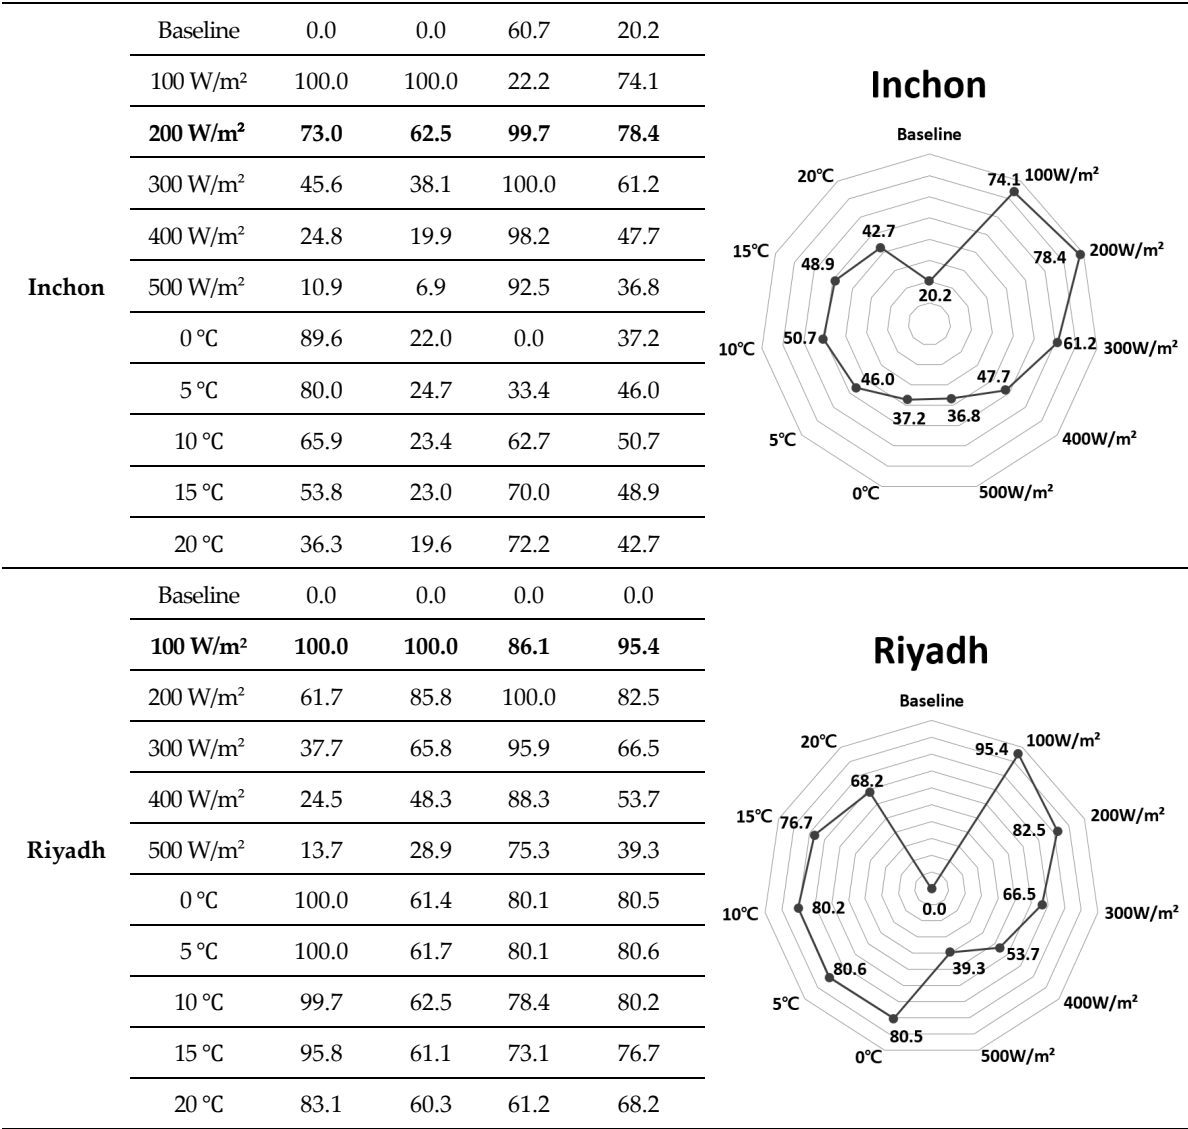

5. Conclusions

In this study, Moscow in Russia, Incheon in Korea, and Riyadh in Saudi Arabia were selected as representative cities for each of three climate zones. Ten conditions for controlling EC glazing were set according to the outdoor temperature and amount of solar radiation. The optimal control condition was derived for each climate zone with respect to the cooling, heating, and lighting load and daylight performance. The results of the analysis can be summarized as follows.

- (1) The results of the analysis of the total annual loads according to the solar radiation control for EC glazing showed that the best conditions for Moscow, Incheon, and Riyadh were 300, 300, and 200 W/m², respectively. The annual load decreased by 23.4% at 200 W/m² in Riyadh, which was the best result. As for the other cities, the annual load was decreased by 4.0% at 300 W/m² in Incheon and 5.8% at 300 W/m² in Moscow. When the daylight performance was analyzed by controlling the solar radiation for EC glazing, the percentage of annual DGI values below 22 was the highest for solar radiation of 100 W/m² in each of the cities that were considered. Higher solar radiation was found to be more disadvantageous with respect to DGI. The results of the analysis of the percentage of annual comfort luminance showed that solar radiation of 100W/m² was the best condition for every city, which corresponded with the DGI analysis result.

- (2) Analysis of the total annual loads according to the temperature control for EC glazing yielded the best performance at 15 °C for Moscow, 20 °C for Incheon, and 0 °C for Riyadh. In particular, Riyadh achieved an 18.8% decrease in the annual load at 0 °C, which was the best performance overall. In the case of Incheon, the annual load decreased by 1.2% at 20 °C, and Moscow showed a 5.8% decrease at 15 °C.
- (3) Analysis of the daylight performance according to temperature control for EC glazing showed that the percentage of annual DGI values below 22 was the highest at 0 °C in every city. However, the result obtained for interior illuminance exhibited a trend that differed from that of DGI. The performance with respect to interior illuminance for Moscow, Incheon, and Riyadh was optimal at 10 °C, 5 °C, and 10 °C, respectively.
- (4) Although the advantages and disadvantages of each control condition for EC glazing could be identified for each climate zone, an integrated method for evaluating the performance in terms of both the cooling, heating, and lighting load and the daylight environment was required. This study utilized the EDPI to comprehensively evaluate the energy and daylight performance. The EDPI-based comprehensive analysis showed that solar radiation of 200 W/m² was the optimal condition for Moscow and Incheon, whereas 100 W/m² was optimal for Riyadh. As for the top 30% of conditions in each climate zone, solar radiation of 200 W/m² was the best condition for Moscow, followed by 100 W/m² and temperature of 10 °C. For Incheon, solar radiation of 200 W/m² was the best condition, followed by 100 W/m² and 300 W/m². For Riyadh, solar radiation of 100 W/m² was the best condition, followed by 200 W/m² and temperature of 5 °C. Thus, in every climate zone that was analyzed, the solar radiation incident on a vertical surface was a more effective variable in controlling EC glazing than the outdoor temperature. Ultimately, solar radiation of 100–200 W/m² proved to be the optimal control condition.

This study used weather data of three climate zones, constructed a single analysis model, and restricted the use of the model to an office building. As the representative climate zones were arbitrarily selected in this study, the optimal control results cannot be standardized. Apart from this, the format of the analysis model was fixed; thus, the results do not imply that the optimal control conditions identified in this study are applicable to every type of building. Accordingly, based on the results of this study, future studies on EC glazing control are planned to analyze more diverse climate zones and to use an analysis model reflecting various building forms and purposes, properties of the building envelope, and the window-to-wall ratio.

Acknowledgments: This research was supported by a grant (18CTAP-C142184-01) from the Technology Advancement Research Program (TARP), funded by the Ministry of Land, Infrastructure, and Transport of the Korean government.

Author Contributions: All authors contributed substantially to all aspects of this article.

Conflicts of Interest: The authors have no conflict of interest to declare.

References

1. Rezaei, S.D.; Shannigrahi, S.; Ramakrishna, S. A review of conventional, advanced, and smart glazing technologies and materials for improving indoor environment. *Sol. Energy Mater. Sol. Cells* **2017**, *159*, 26–51, doi:10.1016/j.solmat.2016.08.026.
2. Piccolo, A. Pennisi, F. Simone, Daylighting performance of an electrochromic window in a small-scale test-cell, *Solar Energy* 2009, *83*, 832–844
3. Fernandes, L.L.; Lee, E.S.; Ward, G. Lighting energy savings potential of split-pane electrochromic windows controlled for daylighting with visual comfort. *Energy Build* **2013**, *61*, 8–20, DOI: 10.1016/j.enbuild.2012.10.057.
4. Rottmann, M.; Kraft, A.; Heckner, K.H.; Hausler, T.; Fischer, U.; Stenzel, H. Large-area electrochromic safety glass; switching behaviour and transmission control of solar radiation. In Proceedings of the 9th International Glass Conference on Glass Processing Days, Tampere, Finland, 17–20 June 2005.

5. Granqvist, C.G.; Bayrak Pehlivan, I.; Niklasson, G.A. Electrochromics on a roll: Web-coating and lamination for smart windows. *Surf. Coat. Technol.* **2017**, 6–11, doi:10.1016/j.surfcoat.2017.08.006
6. V.Costanzo; G.Evola; L.Marletta. Thermal and visual performance of real and theoretical thermochromic glazing solutions for office buildings. *Sol. Energy Mater. Sol. Cells* **2016**, 149, 110–120, doi.org/10.1016/j.solmat.2016.01.008.
7. RubenBaetens; Bjørn Petter; Jelle; ArildGustavsen. Properties, requirements and possibilities of smart windows for dynamic daylight and solar energy control in buildings: A state-of-the-art review. *Sol. Energy Mater. Sol. Cells* **2010**, 94, 87–105, doi.org/10.1016/j.solmat.2009.08.021.
8. Ghosh, A.; Norton, B.; Duffy, A. Daylighting performance and glare calculation of a suspended particle device switchable glazing. *Sol. Energy* **2016**, 132, 114–128.
9. Ghosh, A.; Mallick, T.K. Evaluation of colour properties due to switching behaviour of a PDLC glazing for adaptive building integration. *Renew. Energy* **2018**, 120, 126–133
10. Reilly, S.; Arasteh, D.; Selkowitz, S.E. Thermal and optical analysis of switchable window glazings. *Sol Energy Mater* **1991**, 22, 1–14, DOI: 10.1016/0165-1633(91)90002-3.
11. Lee, E.S.; Yazdanian, M.; Selkowitz, S. The energy-savings potential of electrochromic windows in the US commercial buildings sector. University of California, 2004.
12. Tavares, P.F.; Gaspar, A.R.; Martins, A.G.; Frontini, F. Evaluation of electrochromic windows impact in the energy performance of buildings in Mediterranean climates. *Energy Policy* **2014**, 67, 68–81, DOI: 10.1016/j.enpol.2013.07.038.
13. Ajaji, Y.; André, P. Thermal comfort and visual comfort in an office building equipped with smart electrochromic glazing: an experimental study. *Energy Proc* **2015**, 78, 2464–2469, DOI: 10.1016/j.egypro.2015.11.230.
14. Papaefthimiou, S.; Syrrakou, E.; Yianoulis, P. Energy performance assessment of an electrochromic window. *Thin Solid Films* **2006**, 502, 257–264, DOI: 10.1016/j.tsf.2005.07.294.
15. Myunghwan Oh; Seungjun Roh; Minsu Jang; Jaesung Park. Evaluation of heating and cooling load according to applying electrochromic glass to office building envelope in South Korea. *International journal of sustainable building technology and urban development*. **2018**, 9, 158–169, DOI: org/10.12972/susb.20180015
16. DeForest, N.; Shehabi, A.; Garcia, G.; Greenbalt, J.; Masanet, E.; Lee, E.S.; Selkowitz, S.; Milliron, D.J. Regional performance targets for transparent near-infrared switching electrochromic window glazings. *Build. Environ.* **2013**, 61, 160–168, doi:10.1016/j.buildenv.2012.12.004.
17. Cannavale, G.E.; Eperon, P.; Cossari, A.; Abate, H.J.; Snaith, G.; Gigli, P. Photovoltaichromic cells for building integration. *Energy Environ. Sci.* **2015**, 8, 1578–1584.
18. HALIO Glass, Asahi Glass Co. (AGC). Available online: <https://halioglass.com> (accessed on 9 October 2018).
19. Myunghwan Oh; Sungho Tae; Sangkun Hwang. Analysis of heating and cooling loads of electrochromic glazing in high-rise residential buildings in South Korea. *Sustainability. Sci.* **2018**, 1121, <https://doi.org/10.3390/su10041121>
20. Myunghwan Oh; Jaesung Park; Seungjun Roh; Chulsung Lee. Deducing the Optimal Control Method for Electrochromic Triple Glazing through an Integrated Evaluation of Building Energy and Daylight Performance. *Energies*. **2018**, 11, 2205, doi:org/10.3390/en11092205
21. LBNL. Available online: <https://windows.lbl.gov/software/optics> (accessed on 9 October 2018)
22. LBNL. Available online: <https://windows.lbl.gov/software/window> (accessed on 9 October 2018)
23. EnergyPlus. EnergyPlus Input Output Reference. The Encyclopedic Reference to EnergyPlus Input and Output. <<http://www.energyplus.gov>>, 2012.
24. Arasteh, D.K.; Kohler, J.C.; Griffith, B.T. Draft, modeling windows in EnergyPlus with only U, SHGC, and optionally VT. Lawrence Berkeley National Laboratory Report, 2009.
25. Lomanowski, B.A.; Wright, J.L. Modeling fenestration with shading devices in building energy simulation: a practical approach. Proceedings of the 11th International IBPSA Conference, Glasgow, Scotland, 27–30 July 2009.
26. The Korean Ministry of Land, Transport and Maritime Affairs, Standard for Energy Saving Design in Buildings, 2017. Available online: <http://www.molit.go.kr> (accessed on 9 October 2018).
27. EnergyPlus, EnergyPlus Engineering Reference. The Reference to EnergyPlus Calculations. <<http://www.energyplus.gov>>, 2012. (accessed on 9 October 2018).

- 621 28. *ASHRAE Fundamentals Handbook*; American Society of Heating, Refrigerating and Air-Conditioning
622 Engineers, Inc.: Atlanta, GA, USA, 2009
- 623 29. *EnergyPlus Weather data*, Department of Energy. Available online: <https://energyplus.net/weather>
624 (accessed on 9 October 2018).
- 625 30. Hopkinson, R.G. Glare from daylighting in buildings. *Appl. Ergon.* 1972, 206–215,
626 doi:10.1016/0003-6870(72)90102-0.
- 627 31. KSCI. Available online: <https://standard.go.kr/> (accessed on 9 June 2018).