




Article

# Dynamic, Fully Coupled, Electro-mechanical Models of Tidal Turbines.

Arturo Ortega <sup>1\*</sup>, Joseph Praful Tomy <sup>2</sup>, Jonathan Shek <sup>1</sup>, Stephane Paboeuf <sup>2</sup> and David Ingram <sup>1</sup>

<sup>1</sup> Institute for Energy Systems, School of Engineering, The University of Edinburgh, Colin Maclaurin Road, Edinburgh EH9 3DW, United Kingdom; arturo.ortega@ed.ac.uk (A.O.), j.shek@ed.ac.uk (J.S.), david.ingram@ed.ac.uk (D.I.)

<sup>2</sup> Bureau Veritas Marine & Offshore, Nantes, France; joseph-praful.tomy@bureauveritas.com (J.P.T.), stephane.paboeuf@bureauveritas.com (S.P.)

\*Correspondence: arturo.ortega@ed.ac.uk

**Abstract:** Production of electricity using hydro-kinetic tidal turbines has many challenges that must be overcome to ensure reliable, economic and practical solutions. Energy from flowing water is converted by a system comprising: the turbine rotor blades, a gearbox, an electrical generator, control systems, power electronics, export cables, and a connection to the electricity grid. To date these have often been modelled using simulations of independent systems, lacking bi-directional, real-time, coupling. This approach leads to critical effects being missed. Turbulence in the flow, results in large velocity fluctuations around the blades, causing rapid variation in the shaft torque and generator speed, and consequently in the voltage seen by the power electronics and consequently the export power quality. The resulting poor quality power may be unacceptable to the grid. Conversely, grid frequency and voltage changes can also cause the generator speed to change, resulting in changes to the shaft speed and torque and consequently changes to the lift and drag forces acting on the blades. Clearly, fully integrated, bi-directional, models are needed. Here we present two fully coupled models which use different approaches to model the hydrodynamics of rotor blades. The first model uses Blade Element Momentum Theory (BEMT), resulting in an efficient tool for turbine designers. The second model also uses BEMT combines this with an actuator line model of the blades coupled to an unsteady computational fluid dynamics (CFD) simulation. This simulation, implemented in OpenFOAM, uses an energy balance to compute the shaft speed. Both the BEMT and CFD models are coupled to an Open Modelica model of the electro-mechanical system. Both models have been used to simulate the performance of a 1.2m diameter, scale model, of a three bladed horizontal axis tidal turbine tested in the University of Edinburgh FloWave Ocean Energy Research Facility. The turbulent flow around the blades and the mechanical-electrical variables during the stable period of operation are analysed. Time series and tabulated average values of mechanical thrust, power, torque, and rotational speed as well as electrical variables of generator power, electromagnetic torque, voltage and current are presented for the coupled system simulation. The relationship between the mechanical and electrical variables and the results from both tidal turbine approaches are discussed. Our comparison shows that while the BEMT model provides an effective design tool (leading to slightly more conservative designs), the CFD/BEMT simulations provide more accurate predictions of the blade loads which can be especially important in assessing fatigue on the blades (though at an increased computational cost).

**Keywords:** coupled system; tidal turbine; electrical system; blade element momentum theory; actuator line model; computational fluid dynamics

## 1. Introduction

With increasing awareness of the rise in global temperatures due to carbon emissions, there is a conscious need to meet electricity demand using renewable energy and reduce the consumption of fossil fuels. Tidal turbines have shown the potential to generate vast amounts of clean electricity from the world's oceans and have been in continuous technological development for many years. Despite many of its technical characteristics being inherited from and inspired by offshore wind turbines, tidal turbines are entirely surrounded by water and face significantly different challenges. The surrounding sea presents dynamic and unpredictable behaviour, which can impose undesirable dynamic loads against the turbine structure, particularly the rotor blades. Turbulent flow results in more energy dissipation and less kinetic energy captured by the turbine for power generation.

Another point to be considered is the complexity of the whole system under study: the chain of energy conversion, from capturing the kinetic energy of the tidal flow through to the generation of electrical power for transmission, involves considerable development in a number of individual systems. Firstly the ocean environment in which kinetic energy is to be harvested. Next, the turbine which converts kinetic energy from the flow to mechanical energy through rotor blades rotation. The turbine rotor is connected by a shaft to an electrical generator for conversion of mechanical energy to electrical energy. The electrical generator is managed by a control system to maintain operation at the optimal point. Subsequently, electricity at a fixed voltage and frequency is stepped up by a transformer for power transmission.

Despite the complexity and interaction between different systems within this process of energy conversion, they have so far been studied separately as stand-alone systems; only a few works have started to model it as a coupled system. A study of synthetic turbulence flow models applied to a flume-scale Blade Element Momentum Theory (BEMT) tidal turbine model was carried out by Togneri et al. [1]. Turbulent three-dimensional flow fields were produced by the synthetic turbulence models spectral Sandia and synthetic eddy. The study found a no full reflection of the velocity field spectral properties in the load spectra of the tidal turbine, and a direct relationship between the variability of the tidal turbine loads and the turbulence intensity of the inflow. Using the model of a laboratory-scale three-blades tidal turbine built using Computational Fluid Dynamics/Large Eddy Simulation (CFD/LES) coupled with Actuator Line Model (ALM), Ahmadi and Yang [2] determined a transition zone located shortly behind the simulated tidal turbine with a peak of turbulence intensity. It was found after tracking the streamwise variation of turbulence intensity and turbulent kinetic energy, removing the deterministic velocity fluctuations risen from the tidal turbine rotation.

For the control scheme of the generator side of a tidal turbine system, Zhou et al. [3] proposed an Active Disturbance Rejection Control (ADRC) approach to replace the conventional PI controllers. Under current velocity and turbine torque disturbances, ADRC strategies were tested and compared to achieve Maximum Power Point Tracking (MPPT). The study demonstrated that cascaded ADRC approach slightly improved a tidal turbine system production during swell wave disturbance periods in contrast with the conventional PI controllers. An investigation about the mitigation of undesired torque pulsations by changing the generator speed was presented by Sousounis et al. [4]. The authors propose that the DC link voltage spikes, the electrical components stress increment, and the hazard to grid connection produced by increasing the variation of the generator rotational speed can be overcome by installing a supercapacitor module at the DC link. A coupled system model which involves the surrounding sea, modelled by CFD/LES, a tidal turbine, modelled by ALM/BEMT, and its control system, modelled by MPPT, was presented by Ortega et al. [5]. The simulations showed energy balance between the surrounding sea, the tidal turbine, and the torque controller as the tidal turbine starts to work from the rest up to reach optimal rotational speed. The simulations showed that the turbulence in the inflow is reflected in the time-series output of thrust, torque and rotor power. The results presented good agreement when validated against a laboratory-scale tidal turbine. Sousounis et al. [6] implemented a tide-to-wire model for a tidal current conversion system. BEMT was used to model the mechanical performance of a tidal turbine and it was coupled with an electrical system

developed using a design tool based on the Modelica language. The rotor torque calculated by the BEMT is sent to the electrical system which feedback is the generator rotational speed calculated using an MPPT strategy.

Despite the efforts made to improve the technological development of the tidal turbines from the perspectives of design, construction, deployment, operation, maintenance and energy supply assurance, it is not yet in the commercial stage; and therefore more efforts have to be done to improve those aspects and so that it becomes attractive to governmental and private investments. The objective of this work is to study the variables that involve the transformation of energy from the sea resource to the energy consumption centre from a holistic perspective. It means a tidal turbine rotor blades model is fully coupled to a complete electrical system model. The coupling is carried out by mutual feedback of information balancing their torque over time-domain (torque controller). For the tidal turbine rotor blades model, two approaches are used. The first approach is based on BEMT, and the second approach is also based on BEMT plus CFD to simulate the surrounding sea and body forces to simulate the interaction of the sea with the rotor blades. Each of these tidal turbine rotor blades approaches is coupled to a full electrical system which besides the generator and its controllers, it considers the distribution lines and the grid consumer.

## 2. Numerical Models

In this section, an introduction to the numerical models and approaches used in this work are presented. They are the models used to represent the tidal turbine rotor blades (BEMT and CFD/BEMT), as well as the model which characterises the electrical system, and the approach used to couple the rotor blades with the electrical system. A layout of the models used in this work, and their integration are represented in Figure 1.

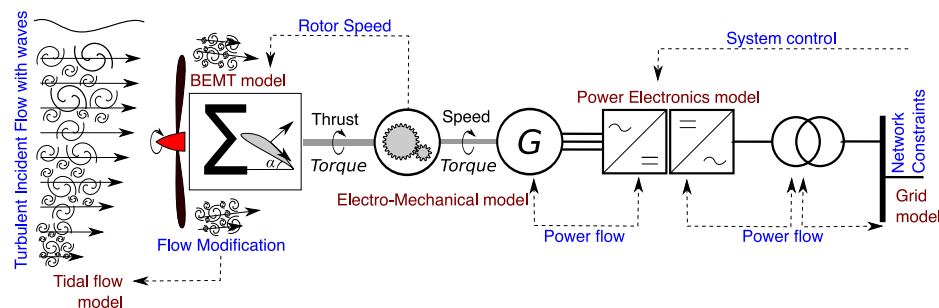


Figure 1. Bi-directional tide-to-wire model of a generalised tidal turbine

### 2.1. BEMT Model

Blade Element Momentum Theory (BEMT) provides the most simplified numerical model of a tidal turbine rotor blades [7], based on classical laws of physics such as Newton's Laws of Motion and conservation of momentum. The flow modification by the rotating turbine is modelled in terms of axial and tangential induction factors. The axial induction factor represents the change in the magnitude of axial velocity in the flow, while passing through the turbine; the tangential induction factor represents the same for the tangential velocity component. These induction factors are then computed by applying the principles of conservation of linear and angular momentum.

The BEMT tool StarBlades was developed by Bureau Veritas based on those concepts [6]. Unsteady hydrodynamics models have been included to improve on the assumptions and limitations of classical BEMT [8]. StarBlades has been tested and validated [10]. The flow domain considered for the BEMT computations is a 2D rectangular plane at the rotor axis. In the BEMT model, the blade geometry is

represented as 1D line elements, with each blade element corresponding to a foil section. For each time step, the model calculates the angle of attack at each blade element of the resultant velocity vector, combining the axial and tangential velocity vectors. The lift and drag coefficients are then interpolated from a tabulated list, for the corresponding angle of attack. Equating the resultant axial force and tangential force to the changes in axial and angular momentum respectively, provides a solution to the BEMT equations.

## 2.2. CFD/BEMT Model

For the CFD/BEMT model, the NREL SOWFA [11] was used. The SOWFA was created to simulate wind turbines applications, however it can be adapted to simulate tidal turbines rotor blades [12,13]. The rotor blades implemented in SOWFA was developed based on ALM [14] and embedded into the OpenFOAM CFD toolbox [15].

The flow domain is simulated by OpenFOAM resolving the Navier-Stoke continuity and momentum equations, considering the flow as incompressible. During the tidal turbine operation, the flow around and downstream of the turbine is considerably turbulent; thus to capture the transient and unstable behaviour of the flow, LES is used to predict the turbulence [16]. At the inlet, synthetic turbulence for the LES model is imposed by a turbulent inflow generator as a custom boundary condition of the OpenFOAM toolbox. The turbulent inflow generator produces turbulence time-series that evolves inside the flow domain. They are calculated based on a specified turbulence length scale, a reference velocity, and the Reynolds stress tensor [17].

The Actuator Line Model (ALM) is used to model the rotor blades and the interaction of the operating blades with the surrounding flow. Similar to the BEMT model (section 2.1), the turbine rotor blades are discretized as a sequence of equally spaced elements. In each blade element, the lift and drag forces are calculated according to a defined airfoil data, twist angle, chord length, and incoming flow velocity follow a look-up tables scheme. Torque and thrust are calculated by integration of these variables along the actuator lines.

In the ALM, the turbine blades react to the hydrodynamic forces imposed by the surrounding flow applying body forces by each blade element. The hydrodynamic forces are projected to the control volumes using a Gaussian formulation which considers the blades as equivalent elliptic platforms. The body forces, which are considered on the Navier-Stokes momentum equations as source term, are equivalent and opposed to the lift and drag forces applied at the blade elements [18]. For a flume tank, the applied body forces can be considered as an external perturbation against the flow domain.

## 2.3. Electrical System Model

The electrical system converts mechanical power from the drive shaft into electrical power and conditions it to make it compatible with the grid connection. This electro-mechanical model used was developed at the University of Edinburgh [19] and has been implemented in OpenModelica [20]. The principal components of the model are the electrical generator and power converter. The input to the electrical system model is the mechanical torque of the rotor,  $T_{mec}^{Gen}$ , which is calculated using the hydrodynamic model of the turbine rotor blades, presented in sections 2.1 and 2.2. In the present case, the generator used is a permanent magnet synchronous generator (PMSG). Both the voltage and frequency of the electricity produced vary with changes in shaft speed. The generators output is conditioned by passing through two back-to-back voltage-source converters connected by DC link. The generator side converter is also used to control the rotation speed of the generator. Speed is controlled using Maximum Power Point Tracking (MPPT) and zero direct-axis current (ZDC) controllers. On the export side, 3-phase AC power is produced at a fixed frequency. The grid side converter is managed using voltage-oriented controller (VOC). Figure 2 shows a block diagram of the electrical system model used in this work [6].

The PMSG implemented in the electrical system model is a direct drive (DD) type and operates at low speed and high torque, so there is no gearbox between the generator and the turbine rotor. ZDC

control aims to set the electromagnetic torque of the generator  $T_e$  equal to an ideal electromagnetic torque  $T_e^*$  by controlling the active power of the generator. In addition to  $T_e^*$ , the three-phase current  $i_{abc}$  at the output of the generator and the generator rotor angle are also required as inputs for ZDC control. MPPT aims to control the tip speed ratio in order to achieve the highest possible power at the turbine rotor. It uses a predefined maximum power point curve (MPPC) at which the power of the turbine rotor is maximised for varying tidal flow velocities at a specific optimal rotor rotational speed. The predefined maximum power point curve is characterized by the constant  $k$ . The speed controller is responsible for comparing the optimal generator speed  $\omega_{opt}^{Gen}$  and the actual generator speed  $\omega_{mec}^{Gen}$  to produce the ideal electromagnetic torque reference  $T_e^*$  to be used as input to the ZDC controller.

The grid side converter is managed by the VOC using decoupled controllers to ensure: a constant DC link voltage; a constant frequency output that synchronised with the grid voltage; and, control over the amount of reactive power flow depending on the grid requirements. Additionally, the electrical system includes harmonic power filters installed in the nacelle of the tidal turbine to reduce grid side harmonics at the switching frequency of the grid side converter. A step-up transformer is also used to increase the voltage levels for power transmission to the shore. The grid side cables for power transmission are modelled as a network of  $\pi$ -sections towards the onshore grid.

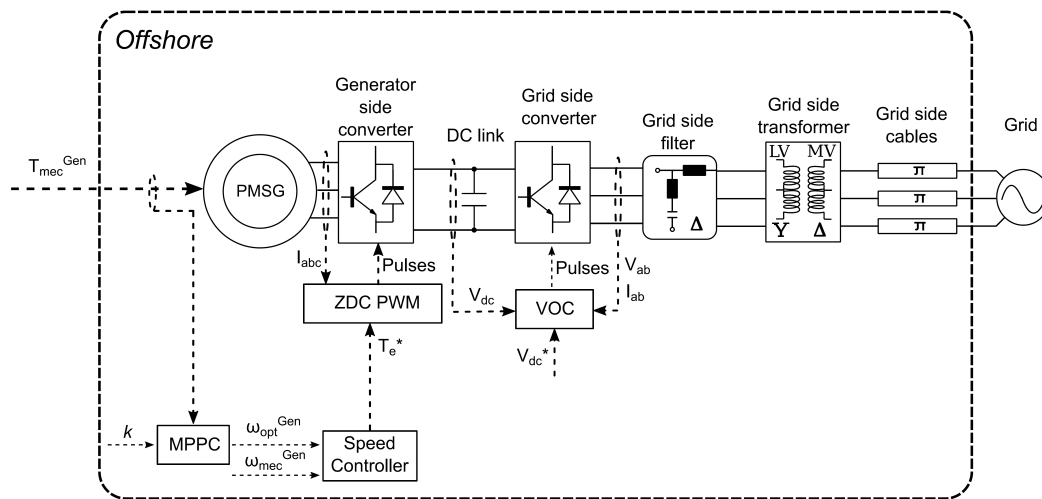


Figure 2. Block diagram of the electrical model of the tidal system, after [6]

#### 2.4. Coupling of Systems

In this work, a fully coupled model of a tidal turbine rotor blades – electrical system was developed. The turbine rotor blades, modelled by BEMT or CFD/BEMT (sections 2.1 and 2.2 respectively), was coupled with the electrical system, described in section 2.3, by an energy balance between the rotor and electromagnetic torques, Figure 1.

The upstream dynamic, turbulent, flow is disturbed by the body forces imposed by the turbine rotor blades. This means that the flow around and downstream close to the turbine is highly disturbed. This flow becomes more stable as it moves further away from the turbine. The hydrodynamic forces, distributed along the actuator lines (rotor blades), generate a resultant mechanical torque (rotor torque) imposed on the shaft, which connects the rotor of the tidal turbine to the generator of the electrical system. The electrical system responds to this perturbation by applying an opposing electromagnetic torque. This torque balance generates a shaft angular acceleration, so modifying the angular velocity of the turbine rotor, shown in equation 1:

$$J \frac{d\omega}{dt} = T_e - T_m - B \cdot \omega \quad (1)$$



where  $T_e$  is the electromagnetic torque (Nm),  $T_m$  is the mechanical rotor torque (Nm),  $\omega$  is the rotor angular speed (rad/s),  $J$  is the turbine and rotor inertia ( $\text{kg}\cdot\text{m}^2$ ), and  $B$  is the viscous friction ( $\text{N}\cdot\text{m}\cdot\text{s}/\text{rad}$ ), which is assumed to be negligible in this work.

At each stage, the updated angular velocity of the rotor modifies the dynamic behaviour of the flow surrounding the turbine. At the next stage, the sequence starts again calculating new values of hydrodynamic forces, mechanical torque, electromagnetic torque, angular rotor speed, and velocity field around the turbine. Therefore, the interaction of the fully coupled tidal turbine rotor blades – electrical system, is demonstrated.

3. Cases Setup

The tidal turbine used is a generic, three-bladed, horizontal axis, model scale device. It is one of three identical turbines originally developed for the UK’s Supergen Marine programme [21] which have been extensively tested in the FloWave Ocean Energy Research Facility [22]. FloWave is a circular wave and current basin, 25 m in diameter and 2 m deep able to create waves and currents in any relative direction simultaneously.

The characteristics of the turbine are presented in Table 1. For the numerical experiment, two cases have been selected with mean flow velocities of 0.6m/s and 1.0 m/s imposed at the inlet. The turbine and generator inertia have been assumed as 1  $\text{kg}\cdot\text{m}^2$  to test the performance of the mechanical - electrical coupled system.

Table 1. Geometrical characteristic of the FloWave generic turbine.

Number of blades	3
Rotor diameter (m)	1.2
Hub diameter (m)	0.12
Hub location over tank bed (m)	1

The BEMT model has been setup as follows. Eleven blade elements were used for the BEMT discretization. The foil lift and drag coefficients were obtained from [23]. The 2D rectangular domain considered for computations has a water depth of 2 m and width of 1 m. For these simulations, There were assumed no variation of velocity over the depth and width of the tank, and no temporal variations of the input velocity field. There is no turbulence model included.

In the case of the CFD/BEMT model, the tank domain was considered as a parallelepiped with a downstream length equal to nine times the rotor diameter, water depth of 2 m, and a transversal length equal to 4 m. The domain was discretized uniformly, with a grid size length equal to 0.018 m. Forty blade elements were allowed for the blade discretization. Both, the tank domain and rotor blades discretization were set up according to the criterion for volume force distributions within ALM on LES. The tidal turbine is located three times the rotor diameter from the inlet to allow flow development for the synthetic turbulent inflow generation. Slip wall boundary condition has been imposed at the bottom, top and lateral sides of the tank domain. At the outlet, the flow is considered complete developed. The stream flow velocities are imposed uniformly at inlet together with synthetic turbulence, generating a turbulent intensity equivalent to 10 %. For both model, BEMT and CFD/BEMT, the selected time step was 0.002 s following the Courant-Friedrichs-Lewy (CLF) criterion based on the rotor tip velocity and to avoid numerical instability.

As the time step used to progress the electrical system is in order of 200  $\mu\text{s}$ , it is necessary for the mechanical simulation to use a much large time step. Consequently, at each mechanical time step,  $\Delta T$ , the electrical solver performs a number of integration steps. Both simulations synchronize at the end of the mechanical time step. In the present simulations the MPPT constant,  $k = 0.3134$ , a value calculated from the FloWave experiments. The parameters describing the electrical generator used in the FloWave experiments are given in Table 2.

Table 2. Electrical generator model parameters.

Rated speed (rad/s)	15.7
Pole pairs	20
Nominal frequency (Hz)	50
Phase resistance ( $\Omega$ )	10.5
D-axis phase inductance (H)	78.5e-3
Q-axis phase inductance (H)	78.5e-3

4. Results and Analysis

Figure 3 presents the turbine rotational speed time-series for the two approaches. The time-series are divided into two parts. The shortest part is the transient period as the rotor turbine starts to work from the rest. Once the turbine, which is working connected to the electrical system, reaches a force balance between the rotor torque and the electromagnetic torque, produced by the generator, a more stable period is presented. The BEMT model reached the stable period faster than the CFD/BEMT model as BEMT is a steady-state program. Whereas, in the CFD/BEMT model the OpenFOAM resolve the Navier-Stoke equations and try to reach a stable behaviour more naturally. The fluctuation of the variable in the CFD/BEMT model is due to the presence of the turbulence. As the free stream velocity increase, higher values of rotational speeds are predicted. Table 3 shows the average values of the turbine rotational speed calculated by the two approaches. Slightly higher values were calculated by the BEMT model and the difference in the results increase as the free stream velocity increase. It is due to more turbulence is generated around the turbine. The percentage difference presented in the table is regarding the CFD/BEMT model.

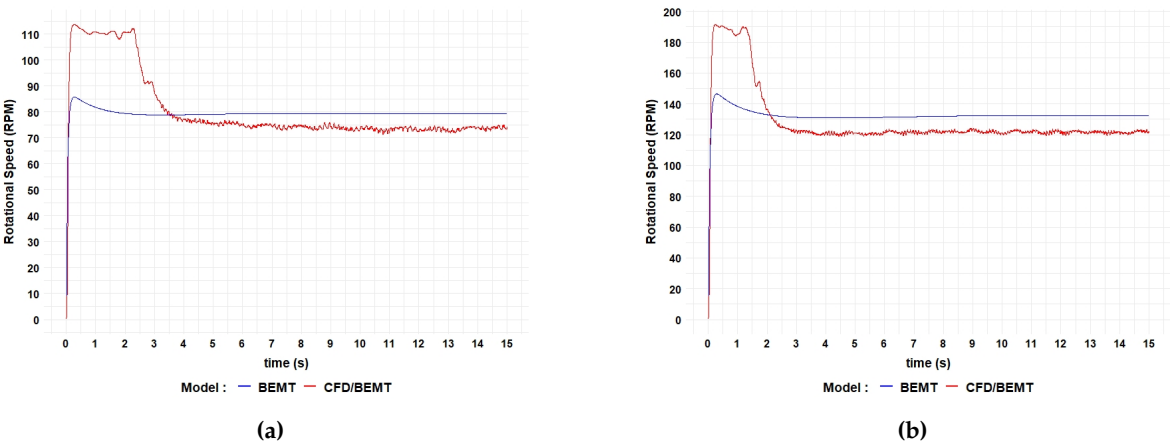


Figure 3. Rotational Speed for (a)  $U_o = 0.6$  m/s and (b)  $U_o = 1.0$  m/s.

Table 3. Average turbine rotational speed.

$U_o$ (m/s)	BEMT (RPM)	CFD/BEMT (RPM)	difference (RPM)	difference (%)
0.6	79.2	73.5	5.7	7.8
1.0	132.1	121.7	10.4	8.5

Figure 4 presents the time-series of the rotor torque predicted by two approaches. Transient and stable periods are presented which is more evident for the CFD/BEMT model in contrast to the steady-state approach of the BEMT model. The level of turbulence is also more evident as the fluctuation of the variable in the CFD/BEMT model. As the free stream velocity is increased, the torque balance between the rotor torque and the electromagnetic torque also increases. Table 4 presents the

average values of the rotor torque during the stable period. Higher values are calculated by the BEMT approach as it does not consider the dissipation of energy caused by the turbulence. Again, increasing the free stream velocity meaning more level of turbulence generated around the turbine. That situation is not captured by the BEMT approach, so increasing the free stream velocity, the difference between the values calculated by two approaches also suffer increment.

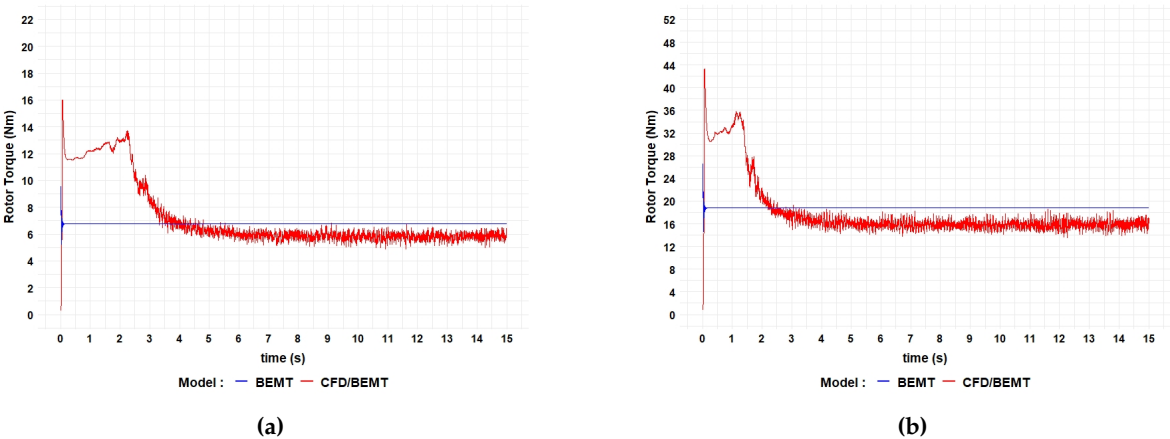


Figure 4. Rotor Torque for (a)  $U_o = 0.6$  m/s and (b)  $U_o = 1.0$  m/s.

Table 4. Average turbine rotor torque.

$U_o$ (m/s)	BEMT (Nm)	CFD/BEMT (Nm)	difference (Nm)	difference (%)
0.6	6.8	5.8	0.9	16.0
1.0	18.8	15.9	2.9	18.3

Figure 5 shows time-series for rotor power by two approaches. The time-series behaviour is similar to the previous figures as the rotor power is calculated by the rotor torque times the turbine rotational speed. There is a stable period after an initial transient as the rotor started in the rest. The CFD/BEMT model took more time to reach a more stable behaviour than the BEMT model which reached quickly a converged solution. The CFD/BEMT model resolves the time-domain Navier-Stoke equations in contrast to the steady-state solution of the BEMT approach. Turbulence generation is synonymous of energy dissipation. The BEMT model is not able to capture the energy dissipation and so more kinetic energy is transformed to rotor power. In contrast, the CFD/BEMT model considers the production of turbulence which energy is dissipated in the flow around and downstream of the turbine, and so less kinetic energy is captured by the rotor turbine. Table 5 shows the average values of the rotor power calculated by two approaches. Higher values were calculated by the BEMT model as it does not consider the energy dissipation by the turbulence. As explained before, the increase of the free stream velocity means more generation of turbulence and less kinetic energy captured to transform in rotor power.



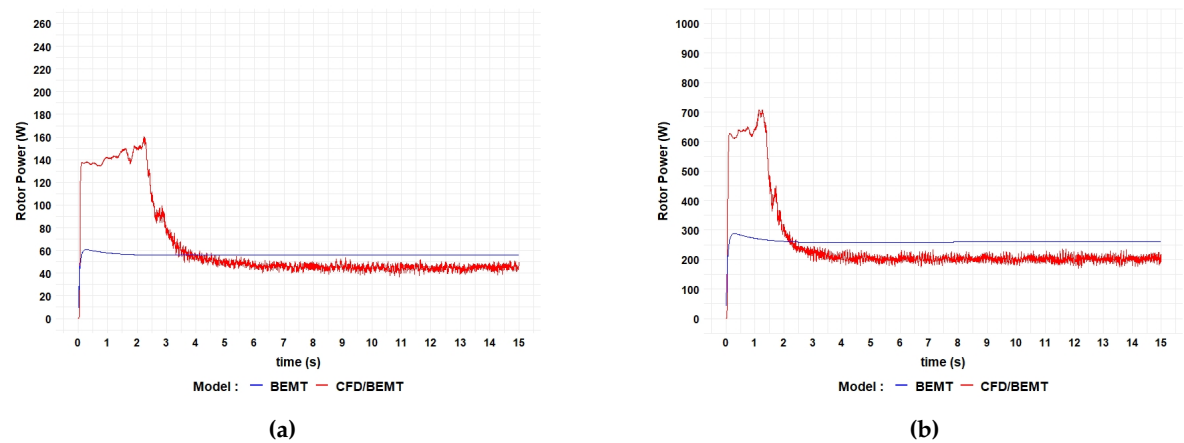


Figure 5. Rotor Power for (a)  $U_o = 0.6$  m/s and (b)  $U_o = 1.0$  m/s.

Table 5. Average turbine rotor power.

$U_o$ (m/s)	BEMT (W)	CFD/BEMT (W)	difference (W)	difference (%)
0.6	56.1	44.8	11.2	25.0
1.0	259.6	202.3	57.3	28.4

272 The behaviour of the thrust over the time domain is presented in Figure 6. Differently to previous  
273 mechanical variables, the values of thrust predicted by the CFD/BEMT model during the stable period  
274 are slightly higher to those calculated by the BEMT model. As the BEMT model does not consider the  
275 influence of the turbulence, it is simulating a slightly more "efficient" turbine, i.e. higher values of rotor  
276 torque and power and lower values of thrust in contrast to the BEMT/CFD model. The turbulence  
277 impact is also reflected in the results shown in Table 6. The difference in the average thrust calculated  
278 between the two models increases according to the increment of the free stream velocity. Higher free  
279 stream velocity means a higher turbulent flow.

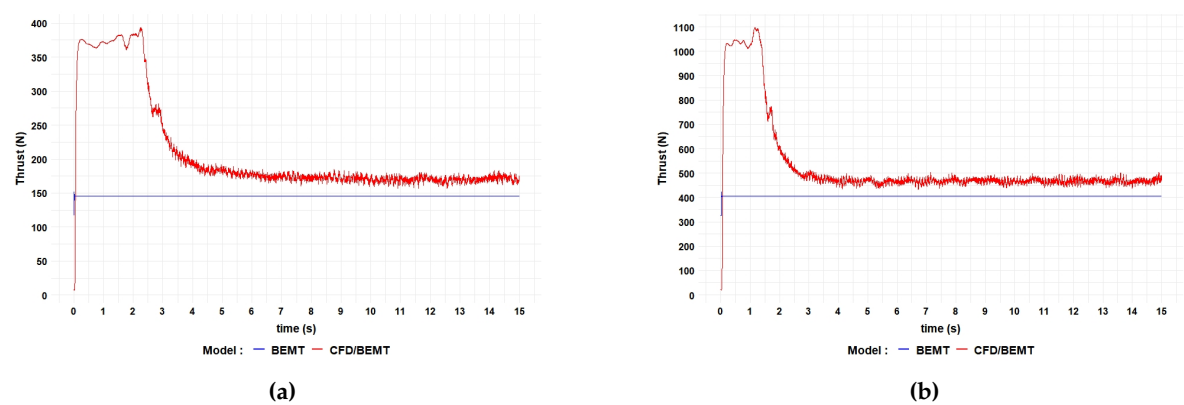


Figure 6. Thrust for (a)  $U_o = 0.6$  m/s and (b)  $U_o = 1.0$  m/s.

Table 6. Average turbine thrust.

Uo (m/s)	BEMT (N)	CFD/BEMT (N)	difference (N)	difference (%)
0.6	145.7	170.3	-24.6	14.4
1.0	404.7	467.0	-62.3	13.3

Next, the results computed by the electrical system are presented. The input to the electrical system model is the time-domain rotor torque at the shaft calculated by the BEMT or CFD/BEMT approaches. As mentioned previously, the rotor torque is a result of an energy balance when the angular shaft acceleration tries to reach zero.

Figure 7 shows the time-series of the electromagnetic torque produced by the generator. Similar to the turbine rotor blades results, the time-series comprises a transient and a stable region. Large fluctuations of the electromagnetic torque were predicted in the case where the CFD/BEMT model was used for the coupled-system. In addition to hydrodynamic effects such as turbulence, large fluctuations are also due to the fast response of the controller to maintain optimum generator speed. Table 7 presents the average values of the electromagnetic torque calculated using the two approaches for the turbine rotor blades. The values are similar to those calculated for the mechanical rotor torque, in Table 4, where the force balance is reached during the stable period, in equation 1, and the angular rotational acceleration tries to reach zero. Similar to the results for the mechanical system, if the free stream velocity increases, the difference in the results between the two approaches also increases. Hence, the influence of the hydrodynamic characteristics, like turbulence, also influences the electrical variables.

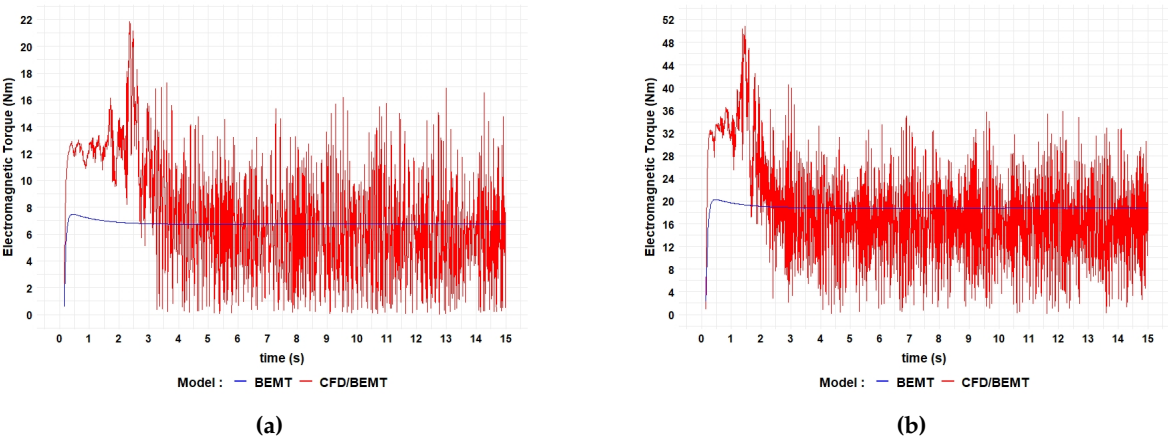


Figure 7. Electromagnetic Torque for (a)  $U_o = 0.6$  m/s and (b)  $U_o = 1.0$  m/s.

Table 7. Average turbine electromagnetic torque.

Uo (m/s)	BEMT (Nm)	CFD/BEMT (Nm)	difference (Nm)	difference (%)
0.6	6.8	5.8	1.0	16.5
1.0	18.8	15.8	2.9	18.5

Figure 8, shows the power output from the generator for the two different flow speeds. Since the generator power is a multiplication of generator speed and electromagnetic torque, it follows a similar profile to that of the electromagnetic torque. Table 8 shows the average values for generator power calculated using the two different methods. The results are very similar to the average values for turbine rotor power, shown in table 5, with the difference attributed to the losses within the generator.

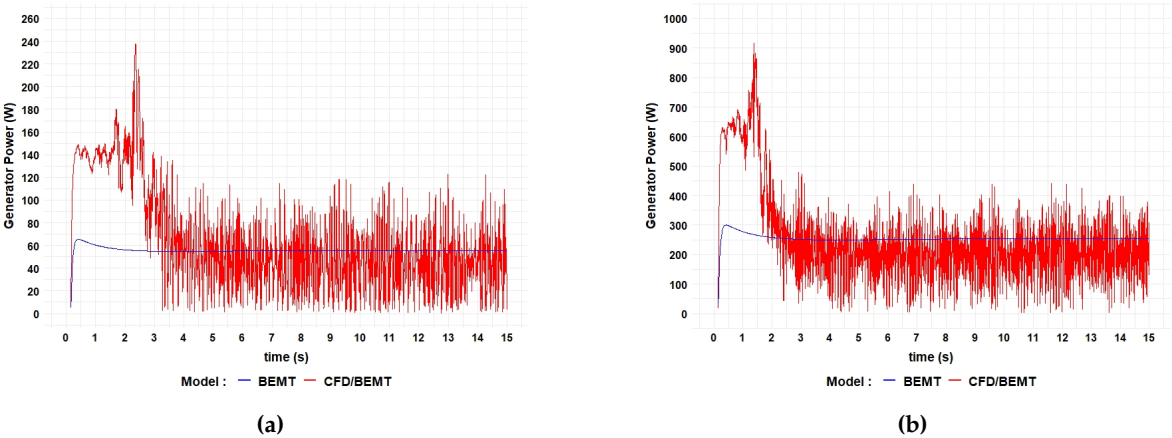


Figure 8. Generator Power for (a)  $U_o = 0.6$  m/s and (b)  $U_o = 1.0$  m/s.

Table 8. Average turbine generator power.

$U_o$ (m/s)	BEMT (W)	CFD/BEMT (W)	difference (W)	difference (%)
0.6	55.2	43.7	11.5	26.3
1.0	253.4	196.2	57.2	29.2

301 The phase voltage at the generator terminals for flow velocities of 0.6 m/s and 1.0 m/s are shown  
302 in figures 9 and 10 respectively. In both figures, the red and blue wave forms can be seen to move  
303 in and out of phase with each other. This is due to a slightly different sampling frequencies between  
304 the two models. The CFD/BEMT model has a higher sampling frequency as it uses a smaller time  
305 step than the BEMT model. The voltage amplitudes, however, are very closely matched between the  
306 two modelling approaches after the initial transient period. Table 9 shows a very consistent average  
307 voltage difference of just below 8% between the two modelling approaches at both flow velocities.

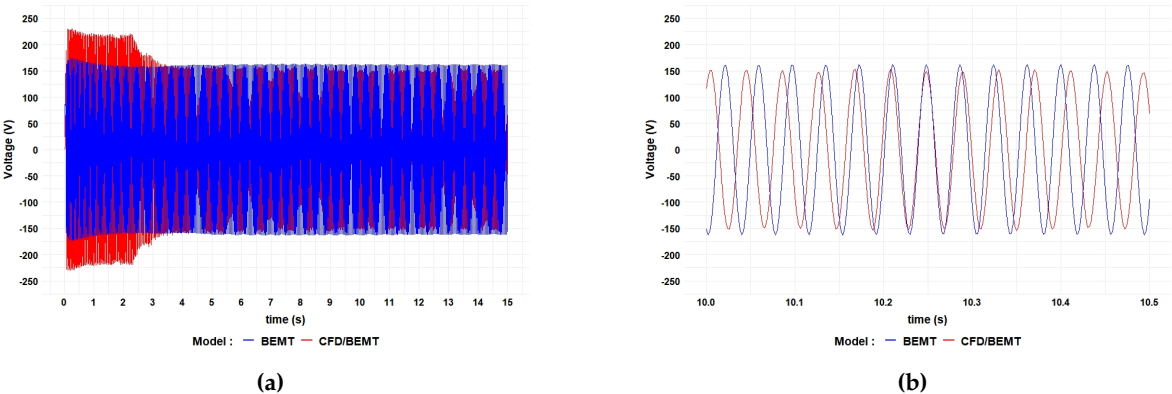
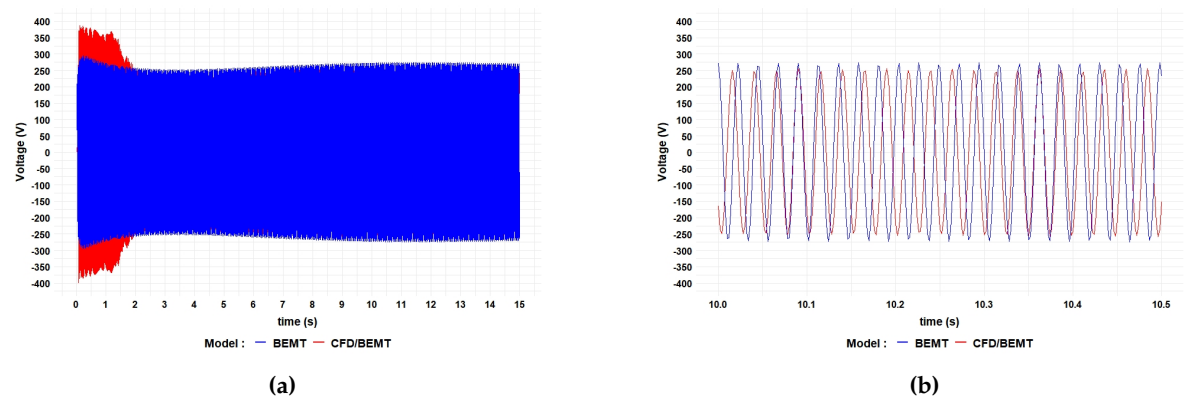


Figure 9. Generator phase voltage at  $U_o = 0.6$  m/s for (a) 15s and (b) between 10.0s and 10.5s.

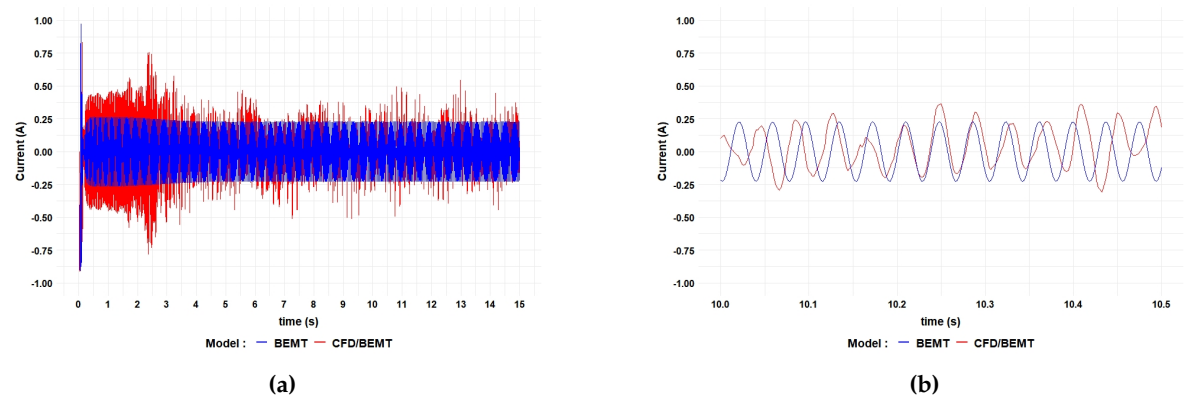


**Figure 10.** Generator phase voltage at  $U_o = 1.0\text{m/s}$ . for (a) 15s and (b) between 10.0s and 10.5s.

**Table 9.** Generator phase voltage (RMS).

$U_o$ (m/s)	BEMT (V)	CFD/BEMT (V)	difference (V)	difference (%)
0.6	114.6	106.2	8.4	7.9
1.0	190.3	176.7	13.5	7.7

308 The current at the generator terminals for flow velocities of 0.6 m/s and 1.0 m/s are shown in  
309 figures 11 and 12 respectively. It can be seen that the amplitude of the current for the BEMT model is  
310 relatively constant with only a slight increase during the transient period. The CFD/BEMT modelling  
311 approach shows more variation in current amplitude; this is particularly noticeable in the wave forms  
312 shown in part (b) of both figures. As with the voltage, there is a slight difference in frequency between  
313 the two models. In this case the BEMT model predicts a slightly higher frequency than the CFD/BEMT  
314 model. Table 10 shows that there is no difference in RMS current, to one decimal place, between the  
315 BEMT and CFD/BEMT modelling approaches.



**Figure 11.** Generator phase current at  $U_o = 0.6\text{m/s}$  for (a) 15s and (b) between 10.0s and 10.5s.

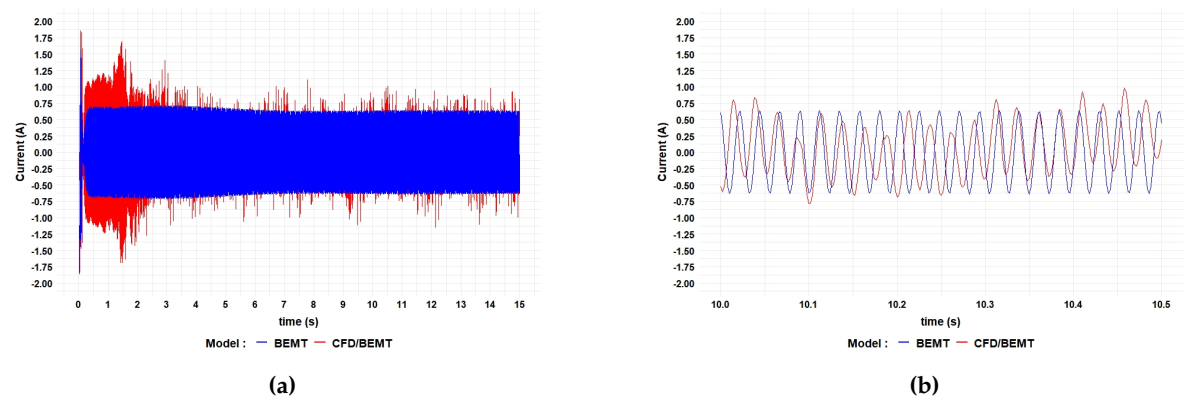


Figure 12. Generator phase current at  $U_o = 1.0\text{m/s}$ . for (a) 15s and (b) between 10.0s and 10.5s.

Table 10. Generator phase current (RMS).

$U_o$ (m/s)	BEMT (A)	CFD/BEMT (A)	difference (A)	difference (%)
0.6	0.161	0.170	-0.009	5.338
1.0	0.448	0.425	0.023	5.491

Table 11 shows the standard deviation of the main mechanical and electrical variables operation of the coupled system at flow velocities of 0.6 m/s and 1.0 m/s using the BEMT/CFD model. For the mechanical variables (thrust, torque and power) and rotational speed, the rise in the standard deviation as increasing the free stream velocity is a consequence of the increase of the turbulence. It means the turbine rotor blades have to gather kinetic energy from a more unstable flow. Although average values for rotor and electrical torque are similar, there is significantly more standard deviation variation in electrical torque, which can be attributed to the fast response of the MPPT controller which tries to maintain maximum power by rapidly adjusting the torque produced by the generator.

Table 11. Standard deviation of the mechanical and electrical variables using the BEMT/CFD approach.

$U_o$ (m/s)	Rotational Speed (RPM)	Thrust (N)	Rotor Torque (Nm)	Rotor Power (W)	Electrical Torque (Nm)	Electrical Power (W)
0.6	0.6	3.9	0.2	2.0	3.4	25.7
1.0	0.8	9.7	0.7	9.0	6.5	79.9

5. Conclusions

In this work, a coupled system, formed by a mechanical and electrical system, was presented. The mechanical system involves the turbine rotor blades and its surrounding sea. A first approach using BEMT was used for the calculation of the hydrodynamics forces at rotor location after approximating the free stream velocity by the use of inductions factors. A second approach called CFD/BEMT was also used. This approach uses CFD and LES to simulate the ocean environment and ALM to simulate the operational blades (BEMT and body forces). In the CFD/BEMT model, the coupling between the surrounding sea and the turbine rotor blades was managed by an energy balance between the imposed hydrodynamic forces (sea against the rotor blades) and the reacted body forces (rotor blades against the sea). The electrical system is composed of a PMSG generator, harmonic filters, a step-up transformer for increasing of voltage levels, lines for power transmission, and an electrical grid. Controllers are also installed in the electrical system to keep the maximum power production and assure the power delivery according to grid requirements.

The coupling between the mechanical and electrical system was carried out by a torque balance (torque controller). The generated mechanical torque at the rotor shaft is countered by the electromagnetic torque. This electromagnetic torque is produced by the generator of the electrical system which is managed by an MPPT to reach maximum values of power generation. There have been a fully coupling between the involved systems, as the torque balance generates an angular acceleration at the shaft updating the rotational speed of the turbine rotor and so modifying the velocity field and turbulence generation surrounding the rotor blades.

Thus, the time-series of the results present two defined periods, the transient and the stable period. For the CFD/BEMT model, the transient period is characterized by an irregular behaviour of the turbine variable as the rotor starts to work at the rest, progressing trying to reach an energy balance over the time. This transient period is followed by a "stable period" where the turbine variable oscillates around an average value. The presented fluctuations during the stable period indicate that the turbulence continuously influences the behaviour of the turbine variable. These situations are not so notorious for the BEMT model, as this model do not consider turbulence and other intrinsic properties of the surrounding sea flow.

The lack of the dynamic flow behaviour in the BEMT model is also reflected in the fact why this model calculated results over (rotational speed, torque and power) and under (thrust) those calculated by the CFD/BEMT model. Part of the tidal stream kinetic energy which is not captured by the turbine is dissipated by turbulence. Thus, the BEMT model does not consider the dissipated turbulent kinetic energy and so, by this model, more tidal stream kinetic energy is been transforming to mechanical power.

The electrical variables, torque and power, have similar behaviour as their mechanical pairs. The results using the CFD/BEM model demonstrated that the electrical variables also are affected by the turbulent flow, plus the perturbation generated by the fast response of the controllers used to keep the turbine working at high levels of power production. Both approaches for the rotor blades, BEMT and CFD/BEMT, presented similar regular behaviour for the generator phase voltage. However, an irregular curve behaviour was predicted by the CFD/BEMT model for the generator phase current also due to the turbulence and the controller response.

The effect of the turbulence is also reflected when the free stream velocity is increased. Higher free stream velocity means mayor captured kinetic energy by the turbine and more dissipated kinetic energy by turbulence. This additional dissipation of turbulent kinetic energy is not considered by the BEMT and so it is reflected in the increment of the difference when compared with the CFD/BEMT model results. Rise of turbulence according to the increase of free stream velocity is also manifested in the rise of the standard deviation of mechanical and electrical variables using the BEMT/CFD model. Higher standard deviation during the stable period means a more unstable flow surrounding the turbine.

The BEMT model demonstrated to be an efficient computational tool. It is able to compute turbine characteristic variables like thrust, torque and power with a low computational effort. In the other hand, the CFD/BEMT model, which needs High-Performance Computing, can give insights into the flow dynamics around the turbine and can calculate turbine characteristic variables considering intrinsic flow properties like turbulence. The use of BEMT models in the design process of a turbine can mean to have a slightly more conservative design, with the advantage of lower computational cost. The use of more complete models like CFD/BEMT can lead to more accurate predictions of the blade loads, like those generated by the presence of turbulence, which is especially important in the fatigue-related design process of a turbine. However, the computational cost necessary to carry out the simulations also needs to be weighed up.

A next step in the study of the coupled system for tidal turbines is to analyse abnormal behaviour during operational conditions. That means any abnormal behaviour in the rotor blades can be reflected in the components of the electrical system. Similarly, any unexpected failure in an electrical component



can compromise the reliability of a mechanical part. Thus, the failure effects can be propagated in the whole coupled system.

**Author Contributions:** CFD/BEMT model, A.O.; BEMT model, J.P.T.; Electrical-System model, J.S.; Coupling of Systems, A.O., J.P.T. and J.S.; writing–original draft preparation, A.O., J.P.T. and J.S.; writing–review and editing, D.I. and S.P.; supervision, D.I. and S.P. All authors have read and agreed to the published version of the manuscript.

**Funding:** This research was funded by the European Commission H2020 Programme for Research & Innovation - "Advanced monitoring, simulation and control of tidal devices in unsteady, highly turbulent realistic tide environments (RealTide Project)", grant number 727689.

**Conflicts of Interest:** The authors declare no conflict of interest.

## References

1. Togneri, M.; Pinon, G.; Carlier, C.; Bex, C.C.; Masters, I. Comparison of synthetic turbulence approaches for blade element momentum theory prediction of tidal turbine performance and loads. *Renewable Energy* **2020**, *145*, 408–418.
2. Ahmadi, M.H.B.; Yang, Z. The evolution of turbulence characteristics in the wake of a horizontal axis tidal stream turbine. *Renewable Energy* **2020**, *151*, 1008–1015.
3. Zhou, Z.; Elghali, S.B.; Benbouzid, M.; Amirat, Y.; Elbouchikhi, E.; Feld, G. Tidal stream turbine control: An active disturbance rejection control approach. *Ocean Engineering* **2020**, *202*.
4. Sousounis, M.C.; Shek, J.K.H.; Sellar, B.G. The effect of supercapacitors in a tidal current conversion system using a torque pulsation mitigation strategy. *Journal of Energy Storage* **2019**, *21*, 445–459.
5. Ortega, A.; Nambiar, A.; Ingram, D.; Sale, D. Torque control of a laboratory scale variable speed hydrokinetic tidal turbine - CFD simulation and validation. *Proceedings of the ASME 2020 39th International Conference on Ocean, Offshore and Arctic Engineering, Virtual Conference* **2020**.
6. Sousounis, M.C.; Tomy, J.P.; Paboeuf, S.; Shek, J.K.H. Tide-to-wire model development for realistic tide environments. *Proceedings of the 13th European Wave and Tidal Energy Conference, Naples, Italy* **2019**.
7. Vogel, C.R.; Willden, R.H.J.; Houlsby, G.T. Blade element momentum theory for a tidal turbine. *Ocean Engineering* **2018**, *169*, 215–226.
8. Scarlett, G.T.; Viola, I.M. Unsteady hydrodynamics of tidal turbine blades. *Renewable Energy* **2020**, *146*, 843–855.
9. Cheng, N.S. Power-law index for velocity profiles in open channel flows. *Advances in Water Resources* **2007**, *30*, 1775–1784.
10. RealTide Project Webpage. Deliverable D3.1 Generalised tide-to-wire model. Available online: <https://www.realtide.eng.ed.ac.uk> (accessed on 27 July 2020).
11. NREL Webpage. Simulator for Wind Farm Applications - SOWFA. *National Renewable Energy Laboratory*. Available online: <https://www.nrel.gov/wind/data-tools.html> (accessed on 27 July 2020).
12. fastFlume Webpage. Available online: <https://github.com/nmmrec/fastFlume> (accessed on 27 July 2020).
13. Sale, D.; Aliseda, A. The flow field of a two-blades horizontal axis turbine via comparison of RANS and LES simulations against experimental PIV flume measurements. *Proceedings of the 4th Marine Energy Technology, Washington DC* **2016**.
14. Sorensen, J.; Shen, W. Numerical Modeling of Wind Turbine Wakes. *Journal of Fluids Engineering* **2002**, *124*, 393–399.
15. The OpenFOAM Foundation Webpage. Available online: <https://www.openfoam.org> (accessed on 27 July 2020).
16. Churchfield, M.; Li, Y.; Moriarty, P. A large-eddy simulation study of wake propagation and power production in an array of tidal-current turbines. *Philosophical Transactions of the Royal Society A* **2013**, *371*, 20120421.
17. LEMOS Webpage. *Institute for Modeling and Numerical Simulation at the University of Rostock*. Available online: <https://github.com/LEMOS-Rostock/LEMOS-2.4.x> (accessed on 27 July 2020).
18. Martinez, L.; Leonardi, S. Wind Turbine Modeling for Computational Fluid Dynamics. *National Renewable Energy Laboratory - NREL* **2012**.

19. Sousounis, M.C. *Electro-Mechanical Modelling of Tidal Arrays*; PhD thesis; The University of Edinburgh: Edinburgh, United Kingdom, 2018.
20. Open Source Modelica Consortium Webpage. Available online: <https://openmodelica.org> (accessed on 27 July 2020).
21. Payne, G.S.; Stallard, T.; Martinez, R. Design and manufacture of a bed supported tidal turbine model for blade and shaft load measurement in turbulent flow and waves. *Renewable Energy* **2017**, *10*, 312–326.
22. Noble, D.R.; Draycott, S.; Nambiar, A.; Sellar, B.G.; Steynor, J.; Kiprakis, A. Experimental Assessment of Flow, Performance, and Loads for Tidal Turbines in a Closely-Spaced Array. *Energies* **2020** *13*(8), 1977.
23. Batten, W.M.J.; Bahaj, A.S.; Molland, A.F.; Chaplin, J.R. Experimentally validated numerical method for the hydrodynamic design of horizontal axis tidal turbines. *Ocean Engineering* **2007**, *34*, 1013–1020.